

REVISIONS	
J. RABA 6-8-11	28





REDRAWN TO AUTOCAD, CHANGED WALL AND FLOOR THICKNESS TO MATCH 341185.

A. VASILE  
6-8-11

R.V./M.F. 29

- UPDATED SIDE WALL THICKNESS, NOTES & EXPLODED VIEW
- ADDED ITEM 10
- UPDATED STOCK NUMBERS FOR ITEM 1, 2, 5, 8
- ADDED VENTED COVER ON ITEM 7
- ADDED SECTION X-X

D.E. 7/27/17

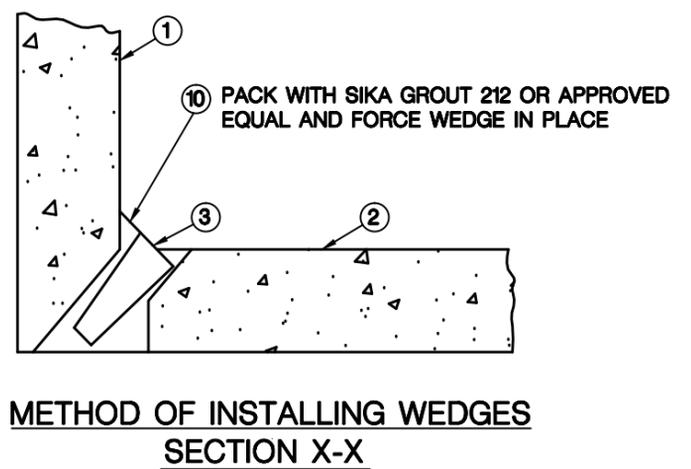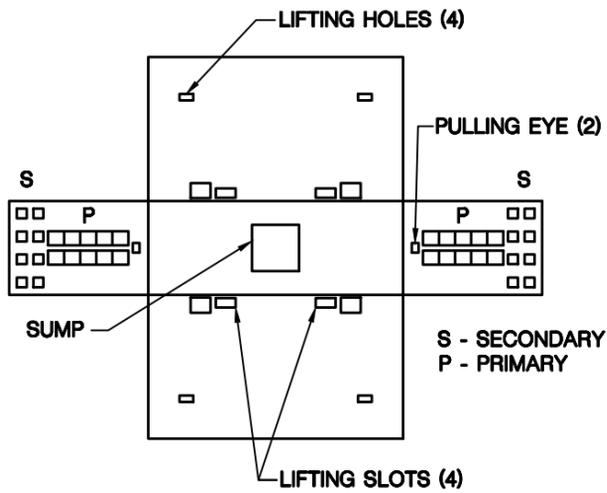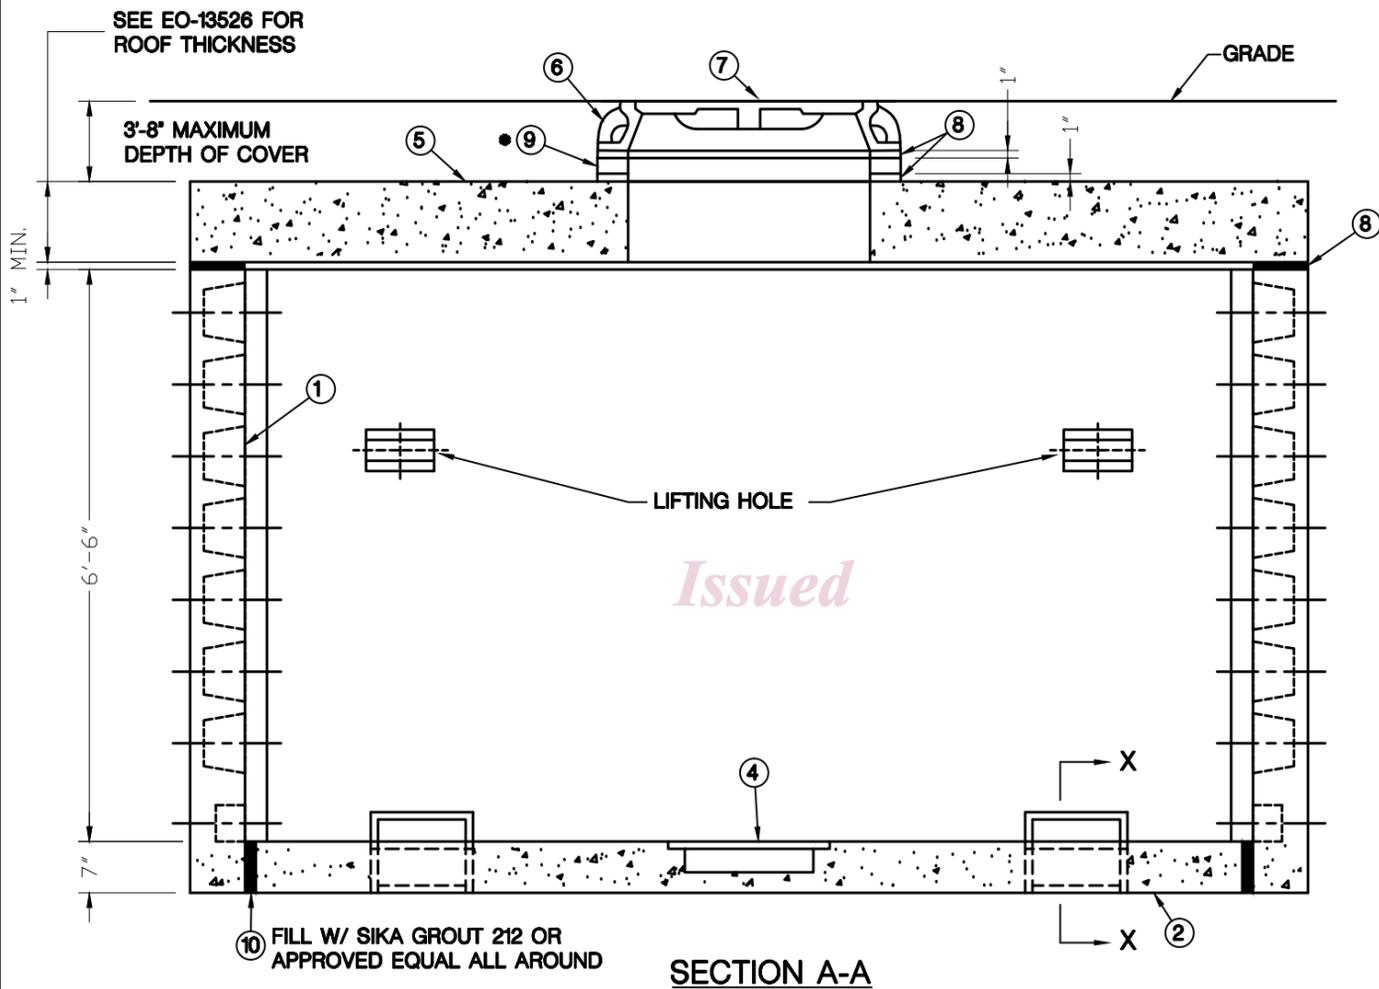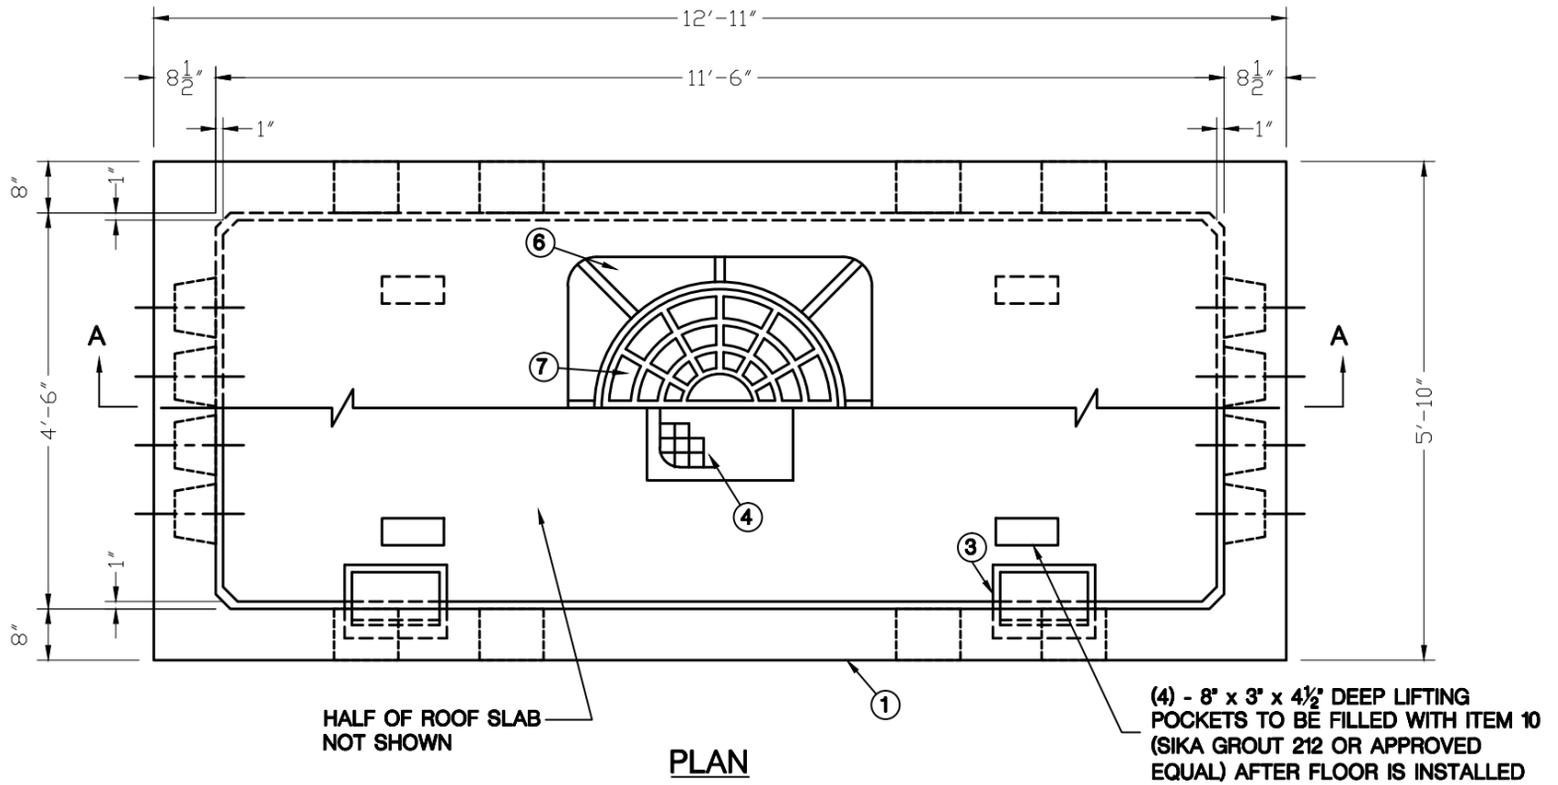

• PROVIDE 4' MIN. CHIMNEY HEIGHT WHERE FIELD CONDITIONS PERMIT.

**NOTES:**

1. IN ROCK EXCAVATIONS INSTALL MANHOLE ON 3" SAND CUSHION.
2. USE SIKA GROUT 212 OR APPROVED EQUAL TO FILL LIFTING POCKETS ON THE FLOOR AND T GAP BETWEEN FLOOR AND WALL. FILL LIFTING HOLES ON WALL AND UNUSED OPENINGS WITH ITEM 8.
3. SET ROOF SLAB CENTERED ON TOP OF WALL WITH (ITEM 8). BUILD COLLAR TO OBTAIN GRADE AND SET CASTING AS PER EO-1092.

**CABLE MANHOLE TYPE M11-6  
INSTALLATION**

11'-6" x 4'-6" x 6'-6"

CONSOLIDATED EDISON COMPANY OF N.Y. INC.  
DISTRIBUTION ENGINEERING DEPT.

DATE: 9/15/54  
LAST REV.: 7/27/17

DWG. NO.: EO-2468-B REV. 29

FIELD MANUAL NO. 17  
SECTION NO. 3  
MANHOLES, CABLES

CONSTRUCTION STD'S  
MANUAL NO. 3  
SECTION NO. 32  
MH'S CABLE

BILL OF MATERIALS					
ITEM NO	QUAN.	DESCRIPTION	DWG. OR SPEC	STOCK NO.	APPROX. WEIGHT IN LBS.
1	1	PRECAST CONCRETE WALLS	341185	NS011540	27,528
2	1	PRECAST CONCRETE FLOOR	341185	NS011551	4,750
3	4	PRECAST CONCRETE WEDGES	341185	---	---
4	1	1'-8" x 1'-8" CAST IRON GRATING	EO-1898-D	003-1500	50
5	1	PRECAST CONCRETE ROOF SLAB <small>CENTERED OPENING</small>	EO-13526-B	NS011553	10,170
6	1	CAST IRON FRAME (TYPE Q-8-7)	EO-13485-C	003-1492	340
7	1	CAST IRON COVER (TYPE Q-8-8)	EO-8359-C	003-5915	320
		DUCTILE IRON VENTED COVER TYPE "Q8" GRATE	345796	003-6487	188
8	AS REQ.	CEMENT MORTAR	EO-100,167	000-0802	---
9	AS REQ.	CHIMNEYS, COLLARS AND GRADING BLOCKS METHODS 1 TO 4	EO-10321-B	---	---
10	AS REQ.	GROUT (SIKA GROUT 212)	---	---	---

Drawers: Attard, Jason S 08/17/2017