




EO-6130-C

REVISIONS

5	CHANGED TITLE SCORING DELETED
6	ADDED STOCK NO'S.
7	REVIEWED. NO CHANGE REQUIRED.

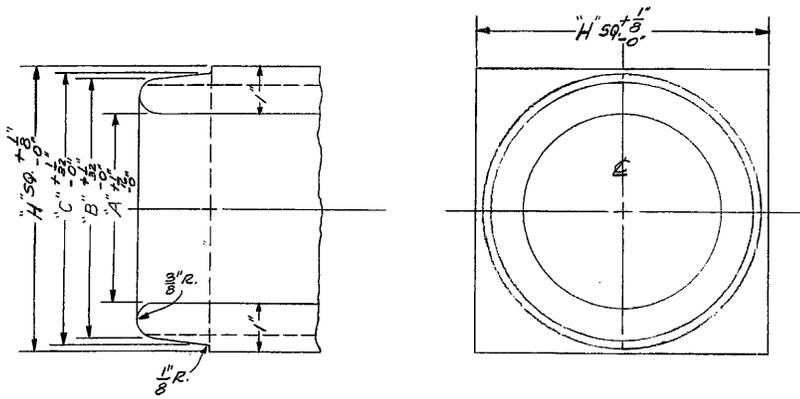

ENLARGED END OF DUCT

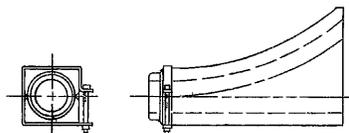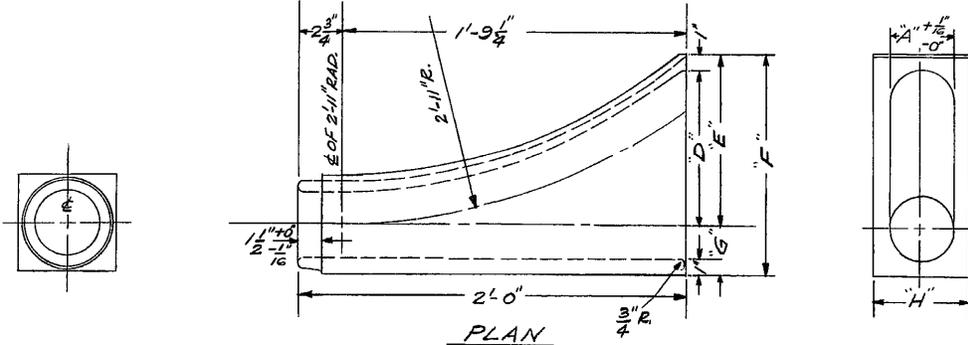

ASSEMBLY OF DUCT AND CLAMP

ITEM	DIMENSIONS IN INCHES								STOCK NO.
	DIAMETERS			D	E	F	G	H	
1	4	5 1/2	5 7/8	9 3/4	10 3/4	13 3/4	3	6	002-1196
2	5	6 1/2	6 7/8	10 1/4	11 1/4	14 3/4	3 1/2	7	002-1014

REF. DWGS.:
 CLAMP FOR CONDUIT...EO-9138-C
 PLASTIC COUPLING FOR
 CONCRETE CONDUIT...EO-9490-D

FLARED CONDUIT FOR PRIMARY CABLE MANHOLE ENTRANCE

THIS DRAWING IS PART OF SPEC. EO-1042.
 TOLERANCES: ± 1/32 UNLESS OTHERWISE SPECIFIED.

CONSOLIDATED EDISON COMPANY OF N.Y., INC.
 DISTRIBUTION ENGINEERING DEPT.
 DATE 9-19-52 DWG. NO. EO-6130-C REV. 7
 LAST REV. 11/26/07

NEXT SCHEDULED REVIEW 6-02		DIV.		SIGNATURE		DATE		DRAWN BY N. GARIBELLANO		DATE 11-30-63		CHECKED BY		DATE	
4 11-30-63 REDRAWN TO PERMIT FIELD SPLITTING		FOR APPROVAL						TRACED BY		SCALE 1/2" = 2'-0"		APPROVED			
REVISIONS		NO.		DATE		APPROVED		DESIGN ENGINEER		DATE 11/23/63		DISTR. STRUCT. ENGR.		DATE	