

EO-7043-03

REVISIONS


P. BERNASCONI 1/13/06 **3**

REDRAWN TO CAD
ADDED ANVL INT'L
FIG. 264

REVISED NOTES,
DESCRIPTION AND
SPECIFICATION
VOLUME.

RAJ. 11/01/05

ADJUSTABLE PIPE SADDLE SUPPORT;
ANVL INT'L FIG 264 (FORMERLY ITT GRINNEL
FIG.264) OR CARPENTER & PATTERSON FIG.101
OR GAS ENGINEERING APPROVED EQUAL.

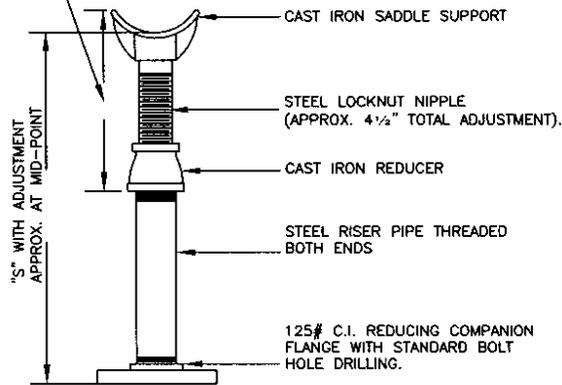

PIPE SUPPORT DATA (INCHES)							
SADDLE SUPPORT SIZE	FOR NOMINAL PIPE SIZE	FLANGE SIZE	S	RISER PIPE (SEE NOTE #3)		REDUCING COMPANION FLANGE SIZE	STOCK NUMBER
				DIA	LENGTH		
2 1/2	1-2 1/2	-	26 1/2	2 1/2	x 18	2 1/2 x 9	-
3	3	-	26	2 1/2	x 18	2 1/2 x 9	-
4	4	1	26	3	x 17	3 x 9	-
6	6	2	24 1/2	3	x 16	3 x 9	003 - 3845
8	8	3	23 1/2	3	x 15	3 x 9	003 - 3837
10	10	4	23	3	x 13	3 x 9	003 - 3829
12	12	6	22	3	x 12	3 x 9	003 - 4157
14	14	8	21	4	x 10 1/2	4 x 11	003 - 3803
16	16	10	20	4	x 9	4 x 11	003 - 3746
20	20	12	18	6	x 6	6 x 13 1/2	003 - 3886
24	24	16	16	6	x 6	6 x 13 1/2	-
30	30	20	13	6	x 6	6 x 13 1/2	-

NOTES:

1. THE MANUFACTURER'S NAME AND PIPE SIZE SHALL BE PERMANENTLY MARKED ON THE PIPE SUPPORT.
2. ALL PIECES TO BE GALVANIZED IN ACCORDANCE WITH A.S.T.M. STANDARD A 153/A 153M-05
3. FOR GR-11 REGULATOR MANHOLES, THE STEEL RISER PIPE LENGTH SHOULD BE 20" FOR SADDLE SUPPORT SIZES 2 1/2" THROUGH 8" AND 18" FOR SADDLE SUPPORT SIZES 10" THROUGH 16".

**PIPE TYPE SADDLE SUPPORT
FOR GAS REGULATOR INSTALLATIONS**

CONSOLIDATED EDISON COMPANY of N.Y., INC.
GAS ENGINEERING DEPT

DATE	2-10-98	DWG.	
LAST REV.	1-13-06	NO.	EO-7043 REV.03

GAS OPERATIONS
VOL. 6.
PURCHASE AND TEST