

8-11821-03

REVISIONS

1-18-61

CHANGED TITLE M.P.F. 1/12/67

1-17-71





CHANGED 350MCM TO 750 MCM. CHANGED BILL OF MATERIAL. V.L. 12-1-71

4-17-71

CHANGED NOTE "F" ADDED ITEM NO. 17 W.D. 4-15-74

5-25-74

CHG'D TITLE, COMPANY CABLES TO COPPER. UPDATED NOTES, PLING INFO. AND B/MATL. N.I.T. 8 4-22-85

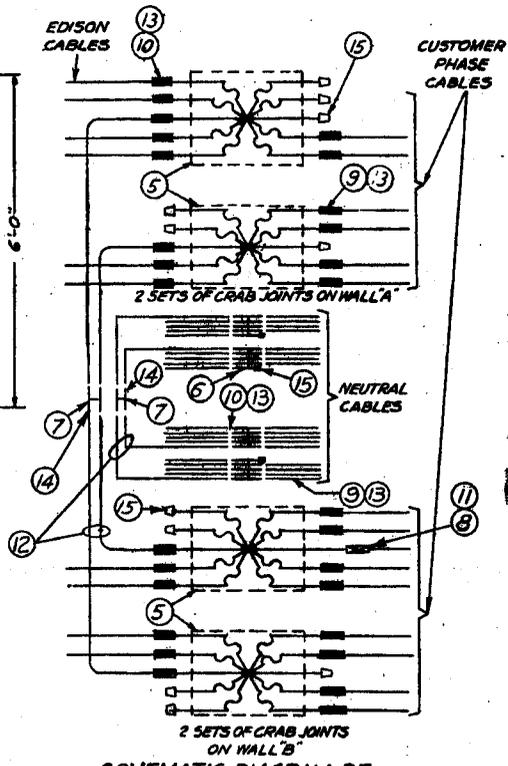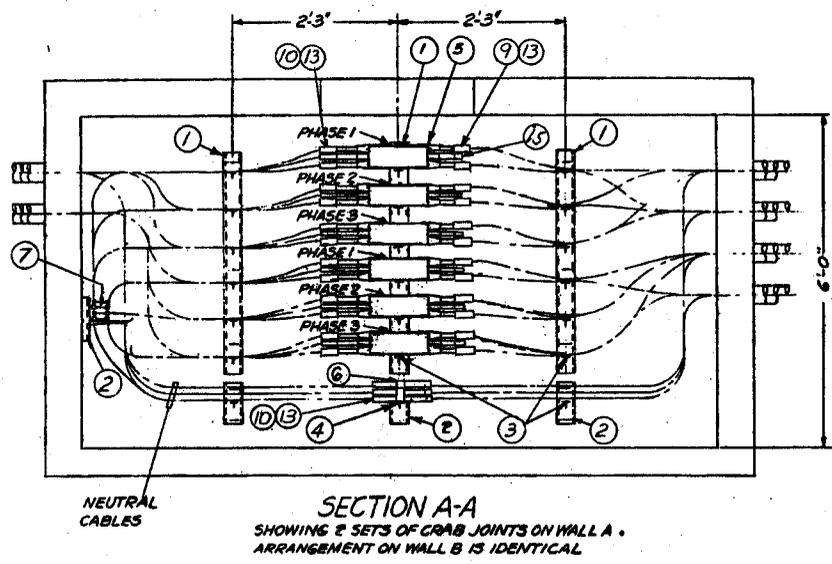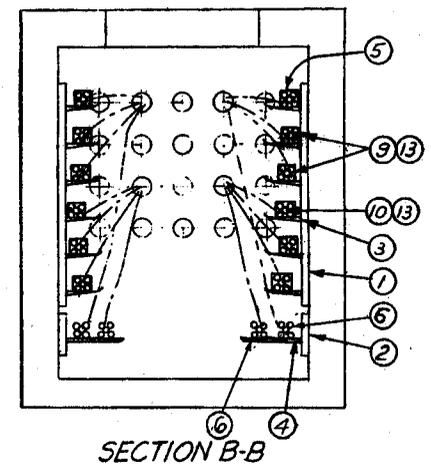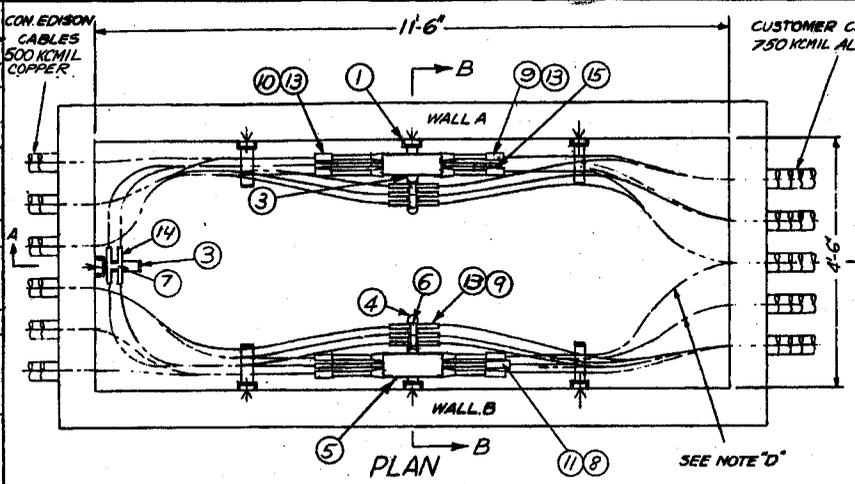

NOTES:

A- RING BUS (ITEM 12) ARE TO BE USED FOR INTERCONNECTION OF CRAB JOINTS.

B- UNUSED CABLE TERMINALS ON CRAB JOINTS SHALL BE INSULATED WITH CAP (ITEM # 15).

C- ALL ITEMS LISTED IN THE BILL OF MATERIALS SHALL BE FURNISHED AND INSTALLED BY THE CUSTOMER. "CUSTOMER" CABLES SHALL BE CONNECTED BY THE CUSTOMER AND "EDISON" CABLES BY THE CON. EDISON CO. OF N.Y.

D- BENDING RADIUS OF CABLE SHALL BE NOT LESS THAN 5 TIMES THE DIAMETER OF THE CABLE.

E- THIS SPECIFICATION APPLIES TO 120/208 VOLT CABLE INSTALLATIONS ONLY, AND SHALL NOT BE USED FOR 480 VOLT INSTALLATIONS.

F- ITEMS SHALL BE PURCHASED FROM COMPANY APPROVED MANUFACTURERS. THE APPROVED MANUFACTURERS FOR CRAB JOINTS ARE BURNDY, HOFER, RICHARDS & MAC.

15	HEAT SHRINKABLE CABLE END CAP 1 5/8" X 3"	ASREQ	EO-13118-B	596-2642
14	HEAT SHRINKABLE TUBE 1 1/2" X 6" FOR 500KCMIL NF TERMINALS	16	EO-13118-B	596-2626
13	HEAT SHRINKABLE TUBE 1 1/2" X 1/4" FOR CONNECTORS	ASREQ	EO-13118-B	596-2832
12	RING BUS CABLE-500KCMIL COPPER EPR NEOPRENE INSULATED	104	EO-609-E	561-1363
11	750-500 COPPER COPPER CORRUGATED ADAPTER	ASREQ	EO-1285-D	570-0760
10	50C KCMIL COPPER CONNECTOR	ASREQ	EO-4147-C	570-1263
9	750-500 ALUMINUM CONNECTOR	ASREQ	EO-7879-D	571-5735
8	750KCMIL ALUMINUM LIMITER, SHELL AND RUBBER SLEEVE	ASREQ	EO-13295-C	570-2907
7	2 WAY 2 WAY 500KCMIL NON-FUSIBLE COPPER CRAB (UNINSULATED)	4	EO-1628-B	573-0064
6	5 WAY-5 WAY 500KCMIL NF COPPER CRAB /BIG TAILS	4		573-0593
5	5 WAY-5 WAY 500KCMIL FUSIBLE COPPER CRAB WITH PIG TAILS	12	EO-9267-B	573-0130
4	RACK ARM 2 WAY	2	EO-2238-C	003-0056
3	RACK ARM 1 WAY	41	EO-2238-C	003-0049
2	STANCHION 1 SLOT	7	EO-2236-C	003-0346
1	STANCHION 6 SLOT 8" CENTERS	6	EO-10302-C	003-0460

REFERENCE DRAWINGS-

SERVICE TERMINATIONS IN PRIVATE PROPERTY LINE BOXES AND MANHOLES - EO-6210-B

11'-8" X 4'-6" X 6'-0" MANHOLE (PRECAST FIELD CONSTRUCTED) - EO-2164-B

EO-1824-B

APPLICATION OF HEAT SHRINKABLE TUBING FOR INSULATING SECONDARY SPLICES - EO-13118-B

ALUMINUM CABLE ARRANGEMENT-120/208V. PROPERTY LINE MANHOLE

16 SETS OF 4-500 KCMIL COPPER CON. ED. CABLES

20 SETS OF 4-750 KCMIL. ALUMINUM CUSTOMER CABLES

ITEM NO.	DESCRIPTION	QUAN.	CON. EDISON SPEC. NO.	CON. EDISON STOCK NO.
----------	-------------	-------	-----------------------	-----------------------

BILL OF MATERIAL (SEE NOTE C)

CONSOLIDATED EDISON COMPANY OF N. Y., INC.

DATE 6-7-66

LAST REV. 4-15-74

DWG. NO. EO-12811-B

REV. 4