


REVISIONS

TLM 02/27/90	12
REDRAWN TO CADAM W.J.T. 1/5/90 JP	
T.L. MATONTE P. PHILIPPIDIS 5/28/93	13
REMOVE "MAX. WIRE SIZE 3#2/0 AWG." ADD "INCLUDING BUS" AND "REQ'D. IF BELOW FLOOR GRADE" V.D. 9/1/93 JP	
V.FERGUSON 3/11/94	14
REMOVED 3'-0" MIN. FROM METER BANK & ADDED NOTE C.W. 3/11/94	
V.FERGUSON 7/24/03	15
CHANGED MAX. HEIGHT FOR METER SOCKETS. G.D. 7/24/03	
C. MAGOULAS 10/2/09	16
CHANGED DEPARTMENT TO ELECTRIC METER SHOP. G.D. 10/2/09	


MULTIPLE ROW INSTALLATIONS

HORIZONTAL TROUGH TYPE WATTHOUR METER SOCKETS (TABLE IV C AND IV D)

SINGLE ROW INSTALLATIONS

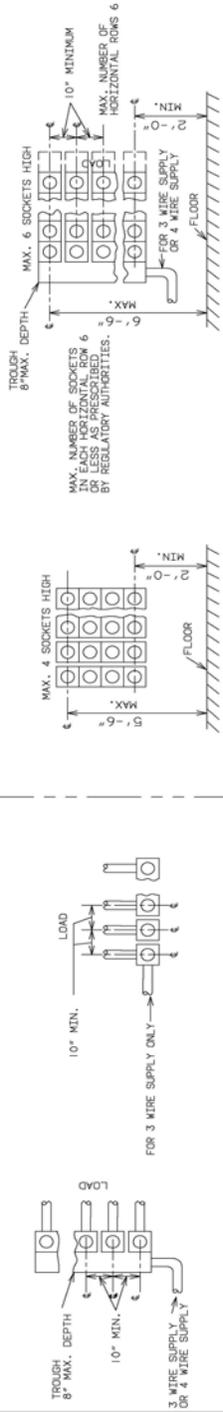

WIRING DIAGRAMS

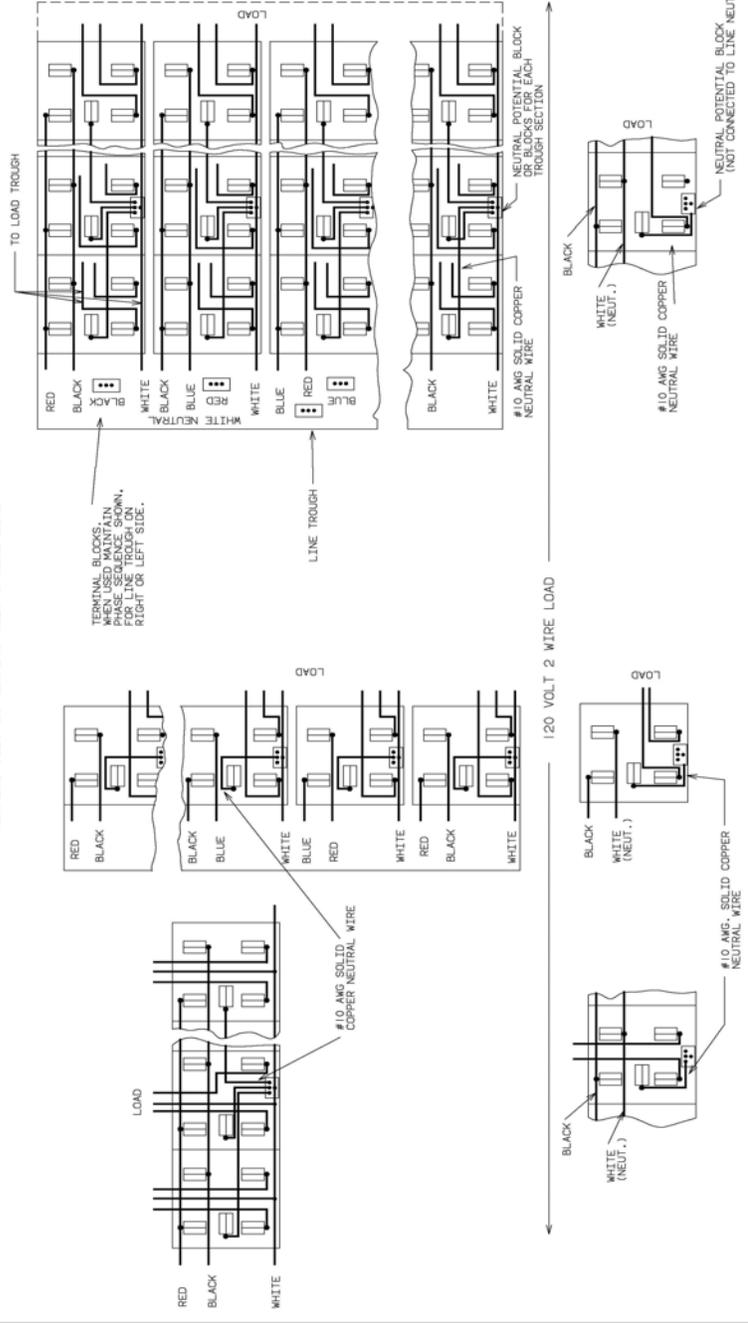

REFERENCE DWG.

WATTHOUR METER SOCKETS (SHEET 1)EO-9053-B
 FOR ADDITIONAL NOTES AND INFORMATION. SEE SHEET 1
 REFERENCE TABLES APPLY TO BOOKLET "APPROVED ELECTRIC SERVICE EQUIPMENT"

WATTHOUR METER SOCKETS
 ON LOAD SIDE OF METER DISCONNECT.
 (SHEET 2 OF 2)

CONSOLIDATED EDISON COMPANY OF N. Y. INC.
 ELECTRIC METER SHOP

DATE 2/25/59
 LAST REV. 10/2/09
 MES 447
 REV. 16

COMPUTER GENERATED DRAWING NOT TO BE HAND REVISED

FOR APPROVAL	DIV	SIGNATURE	DATE	DRAWN BY	DATE	CHECKED BY	DATE