
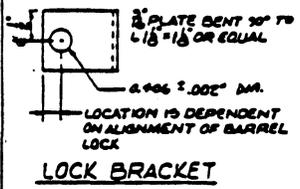
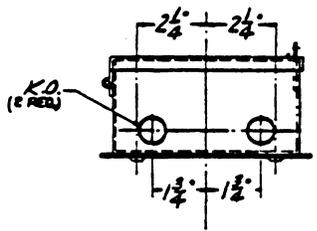
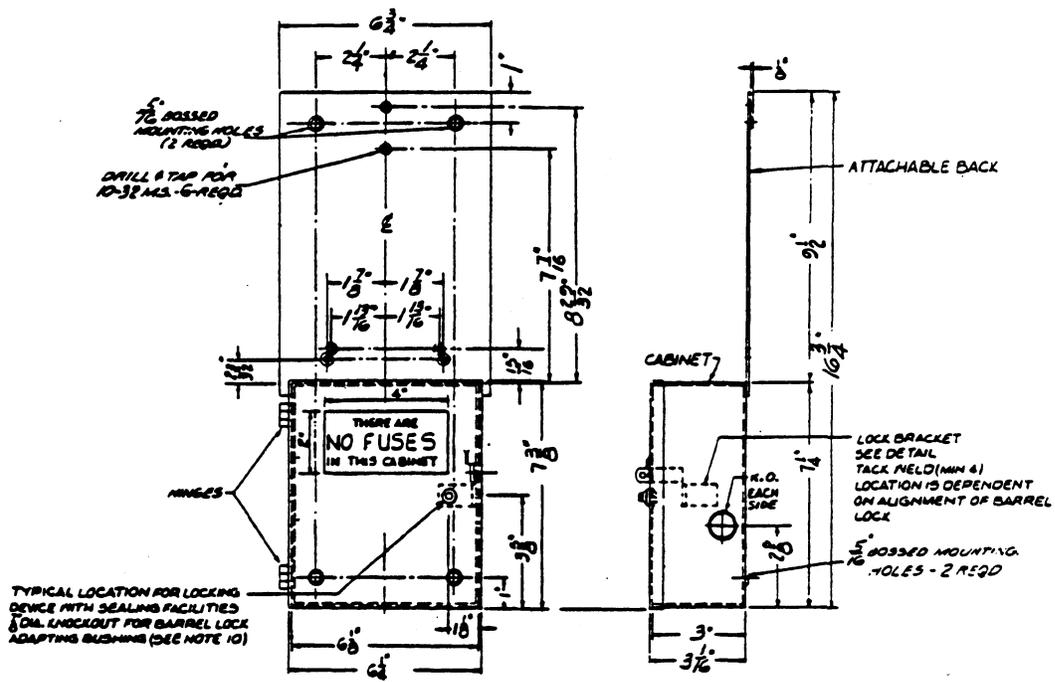


8-E-21107

REVISIONS	
1	2-2-25 4
ADDED NOTES 11, 612, LOCK BRACKET & UPDATE DWG. C.M. 1-23-05	

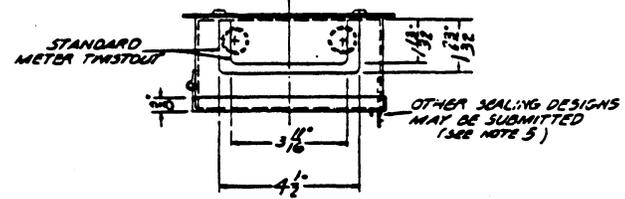

- GENERAL NOTES:**
1. THE EQUIPMENT SHALL BE OF 16 G.U.S. GAUGE SHEET STEEL
 2. ALL STEEL SURFACES SHALL HAVE 2 FINISH OF BARED GRAY ENAMEL.
 3. TAPPED HOLES SHALL HAVE AT LEAST THREE COMPLETE THREADS.
 4. UNKNOCKOUTS SHALL BE CONCENTRIC FOR 3/4" AND 1" CONDUIT.
 5. FACILITIES SHALL BE PROVIDED FOR CABINET WITH TO ACCOMMODATE STANDARD SEALS, AND KNOCKOUT WITH 3/8" DIA. HUB.
 6. AN EQUIPMENT FOR USE ON 120 VOLTS SHALL BE PROVIDED WITH A FUSE RECEPTACLE, AND AN EQUIPMENT FOR USE ON 250 VOLTS SHALL BE PROVIDED WITH A CIRCUIT TYPE DISCONNECT SWITCH MOUNTED ON AN INSULATED AND EXTENDING 1" BEYOND TERMINALS.
 7. CABINET DEPTH SHOWN IS FOR 110 VOLT EQUIPMENT DEPTH MAY BE INCREASED FOR 250 VOLT EQUIPMENT DEPTH REQUIRED TO PROVIDE PROPER CLEARANCE FOR THE DISC LINK.
 8. AN EQUIPMENT FOR USE ON 250 VOLT CIRCUITS SHALL HAVE A DIFFERENT LABELING NUMBER FROM THAT FOR USE ON 120 VOLT CIRCUITS.
 9. A NAME PLATE SHALL BE ON THE OUTSIDE OF THE COVER AND CONTAIN MANUFACTURER'S NAME, TYPE, NO. AND VOLTAGE RATING.
 10. HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE CAT. NO. 95589002 HIGHFIELD MFG. CO. BRIDGEPORT, CONN. OR SBRACKS BARREL LOCK GUARD NO. 04300, E.J. BROOKS CO. NEWARK, NEW JERSEY.
 11. SAMPLES OF THE EQUIPMENT SHALL BE SUBMITTED TO THE DISTRIBUTION INSTRUMENTATION ENGINEER FOR APPROVAL.
 12. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS AND THE DEPARTMENT OF PUBLIC WORKS OF THE CITY OF NEW YORK. MANUFACTURER SHALL OBTAIN UNDERWRITERS LABORATORIES APPROVAL.

FIELD MANUAL #4
SECT. 6
FIELD MANUAL #6
SECT. 2

1	REVISIONS
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	
36	
37	
38	
39	
40	
41	
42	
43	
44	
45	
46	
47	
48	
49	
50	

MOUNTING EQUIPMENT FOR INDICATING OR CUMULATIVE DEMAND METER EQUIPMENT

CONSOLIDATED EDISON COMPANY OF N. Y. INC.
ELECTRICAL ENGINEERING DEPT.

DATE 6-15-30
LAST REV. 1-23-05

NO. 151

REV. 4