
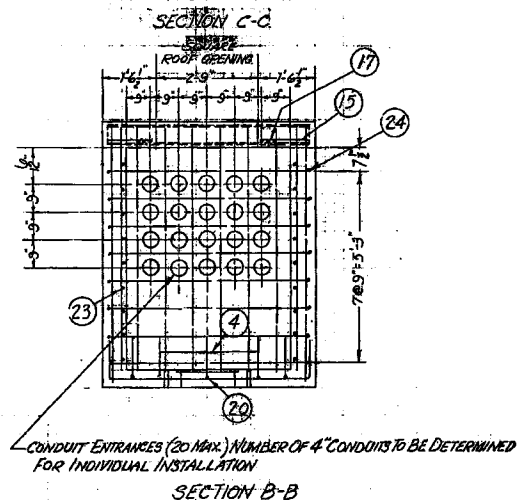
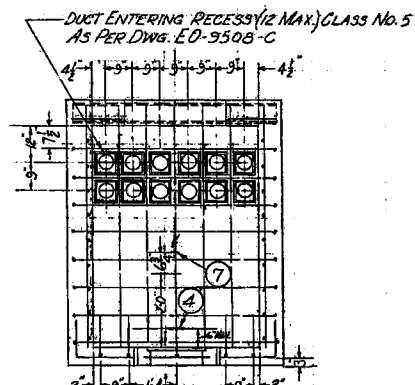
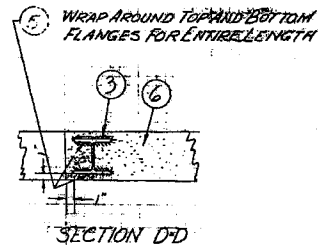
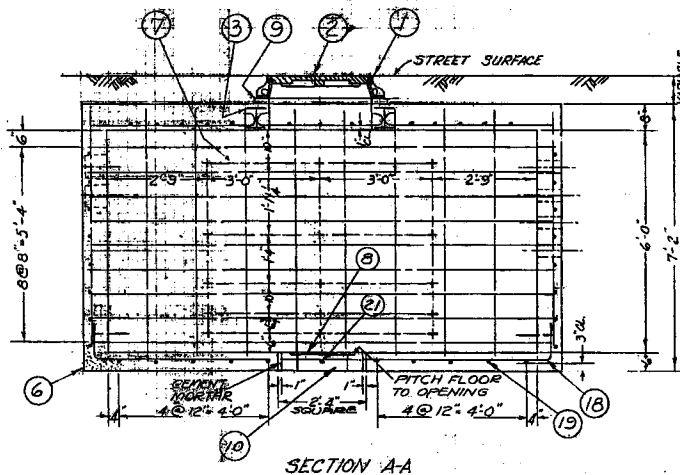


57611-01

REVISIONS

REMOVED "STAINLESS STEEL" FROM ITEM 5.

J.P. 1-22-70

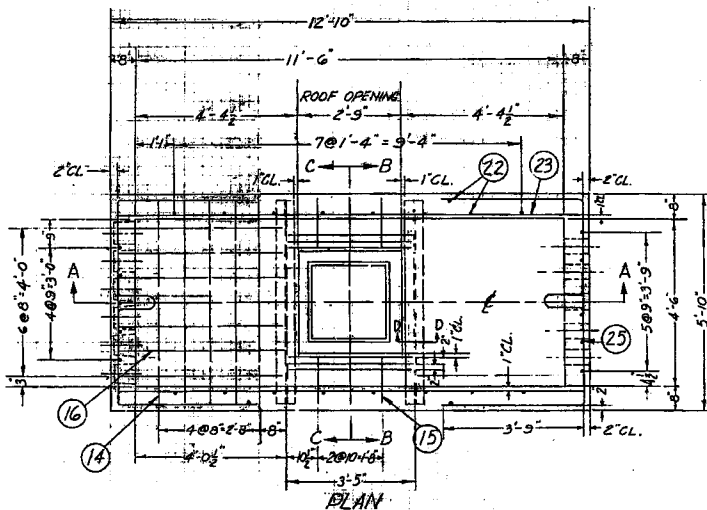

ITEM NO.	LOCATION	QUANTITY	SHAPE (DIMENSIONS OUT TO OUT)	WEIGHT (LBS)	STRUCTURAL TOTAL
25	ENDWALL	11	#5 6'-10"	1095	1095
24	ENDWALL	16	#6 3'-9" 5'-6" 3'-9"	275	275
23	SIDE WALL	18	#5 12'-6"	1500	1500
22	SIDE WALL	20	#5 6'-10"	1095	1095
21	FLOOR	2	#5 1'-2" 1'-8"	100	100
20	FLOOR	2	#5 1'-1" 5'-2"	100	100
19	FLOOR	10	#5 1'-2" 5'-6" 1'-2"	1000	1000
18	FLOOR	4	#5 1'-1" 12'-3" 1'-1"	1000	1000
17	ROOF	6	#5 3'-4"	100	100
16	ROOF	14	#5 4'-8"	1000	1000
15	ROOF	6	#5 1'-3"	100	100
14	ROOF	10	#5 5'-2"	1000	1000

REINFORCEMENT SCHEDULE

WEIGHT OF STEEL

CONSTRUCTION DEPT				
FIELD MANUAL NO. 11	10	1	PRECAST CONCRETE ADAPTER OR PRECAST CONCRETE SUMP	EO-6403-C
SUBWAY				EO-1843-D
SECTION: MANHOLES	9	AS REQD.	GRADING BLOCKS - SEE SPECS.	EO-10321-B
BOXES, FIELD MAN.	8	1	CAST IRON GRATING	EO-1898-G
NO. 17 SURVEY GROUP	7	32	3/8" INSERTS	EO-100133
SECTION: CABLE	6	84 CUBIC YDS	CONCRETE - CLASS II	EO-1008
MANHOLES	5	AS REQD.	#13 GA EXPANDED METAL .84 SQ. FT.	
	4	2	PULLING EYE	ITEM 1 EO-7841-C
CONSTRUCTION STD'S	3	2	6" X 25'-5'-6" LG.	
MANUAL NO. 3	2	1	MANHOLE COVER 9'-8" S	EO-3349-B
SECTION # 32	1	1	MANHOLE FRAME 9'-8" S	EO-13465-C
CABLE, MANHOLES	ITEM NO.	QUAN.	DESCRIPTION	REF. DWG OR SPEC.
	BILL OF MATERIAL			

BILL OF MATERIAL

MATERIAL SPECIFICATIONS - ALL REINFORCEMENT BARS SHALL BE BILLET STEEL, DEFORMED, INTERMEDIATE GRADE AND SHALL CONFORM TO A.S.T.M. DES. A615, GRADE 40. STRUCTURAL STEEL SHALL CONFORM TO A.S.T.M. DESIGNATION A-36.

CONSTRUCTION SPECIFICATIONS - ALL REINFORCEMENT BARS SHALL BE WIRE TIED AT ALL CONTACT POINTS. PULLING EYES, ITEM 4 SHALL BE WIRE TIED TO REINFORCEMENT BARS. USE APPROPRIATE METHOD SHOWN ON E0-10321-B TO OBTAIN GRADE.

REFERENCE DWGS: DUCT ENTERING RECESS - E0-9508-C

CUSTOMER'S PROPERTY LINE CABLE MANHOLE FIELD CONSTRUCTED - 11'-6" x 4'-6" x 6'-0"

CONSOLIDATED EDISON COMPANY OF N. Y., INC.

DATE 12-17-63
LAST REV. 1-22-70

DWG. NO. E0-11924-B

REV. 2