EO-12464-C

REVISIONS

R. Bennett 1-29-69	1
REMOVED TM10-6 D.R. 8-1-67	
M. Schum 12/19/80	2
UPDATED FILING INFO. C.W. 12-8-80	
M. Scherr 12/21/84	3
UPDATED WALL THICKNESS OF TM-11 & CV8-6, UPDATED FILING INFORMATION J.P. 3-13-84	

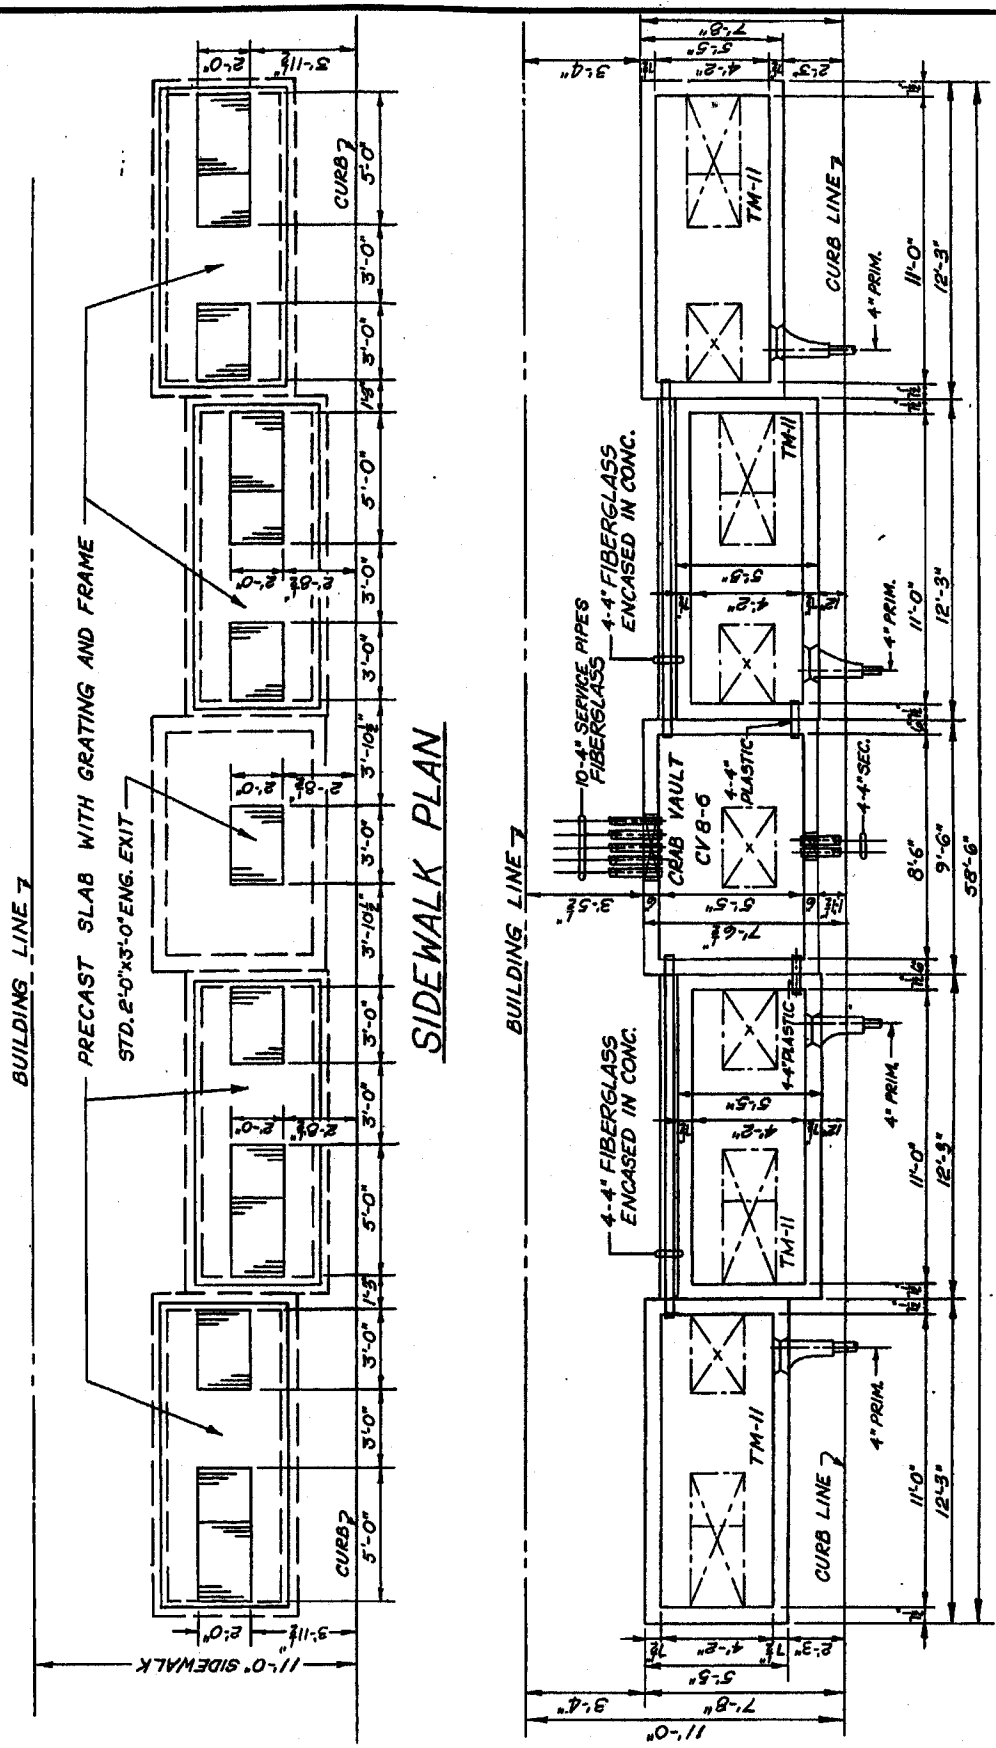

REFERENCE DWG'S
INSTALLATION TRANSF. MANHOLE, TYPE TM11 — EO-2156-B
INSTALLATION CRAB VAULT, TYPE CV8-6 — EO-11406-B

NOTE:
TM11 IS STANDARD IN ALL DISTRICTS

FIELD MANUALS
NO 5: VAULT INSTL
SECT. I UNGRND TRANSF. INSTL. VAULTS & M.H.
NO. 11: SUBWAY CONSTR.
SECT. III: SUB-SECT. VAULTS, CRAB
NO. 17: SURVEY
SECT. III: SUB-SECT. VAULTS, CRAB

CONSTR. STDS. MANUAL #3 SECTION NO. 42 VAULTS

MULTIPLE 500 K.V.A. TRANSFORMER INSTALLATIONS WITH CV 8-6 CRAB JOINT VAULT

CONSOLIDATED EDISON COMPANY OF N.Y., INC.
ELECTRICAL ENGINEERING DEPT

DATE 6-9-65
LAST REV. 3-14-84
DWG. NO. EO-12464-C REV. 3