


0-96991-03

REVISIONS

E. CHAM 9/25/18 2

RE-DREW IN AUTOCAD. REMOVED NOTE 3 REMOVED TRANSF. SINGLE PHASE PAD. ADDED "REAR" & "FRONT" ADDED REFERENCE SPECS.

K.T. 9/25/2018

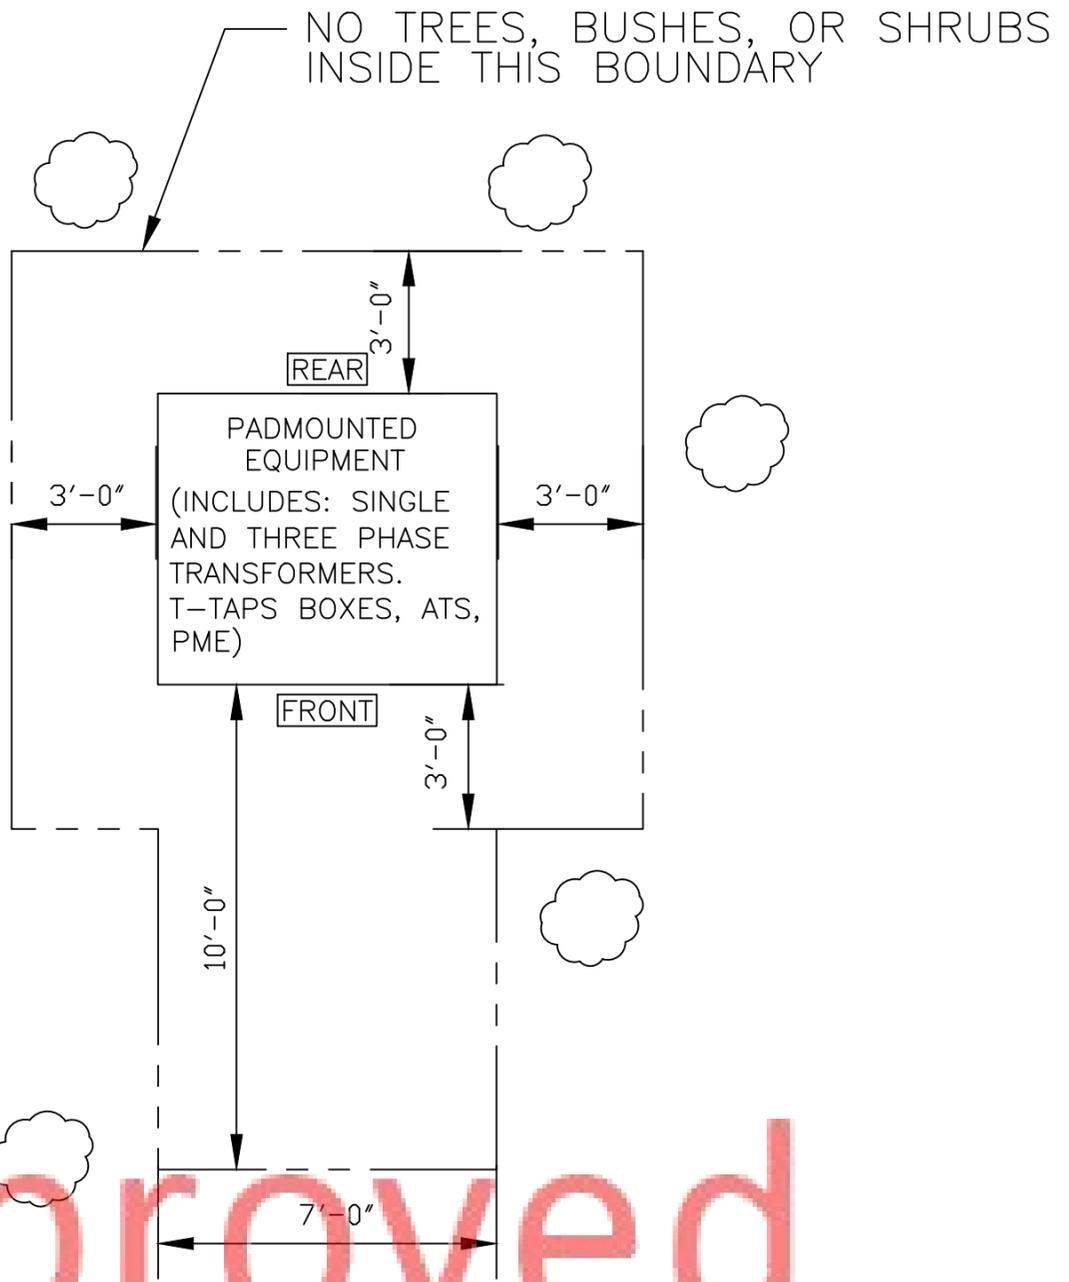

NOTES:

1. THE AREA IN FRONT OF THE FRONT DOOR SHALL BE CLEAR OF ALL ROCKS, STUMPS AND OTHER OBSTRUCTIONS SO THAT THE OPERATOR HAS A SAFE WORKING AREA.
2. THE COMPANY SHALL HAVE THE RIGHT TO CUT BACK GROWING BUSHES TO WITHIN STATED CLEARANCES.

REFERENCE SPECS:

PURCHASE REQUIREMENT FOR EQUIPMENT SAFETY LABELS OR WARNING TAGS \_ \_ \_ \_ \_ EO-3101

CONCRETE PAD FOR THREE PHASE PAD MOUNTED TRANSFORMERS \_ \_ \_ \_ \_ EO-13775-B

HL-45 FIBERGLASS BOX PAD FOR MINIPAD TRANSFORMERS \_ \_ \_ \_ \_ 326199

INSTALLATION OF 13KV THREE PHASE PME (PAD-MOUNTED EQUIPMENT) SWITCHES \_ \_ \_ \_ 328192

CLEARANCE REQUIREMENTS FOR OIL-FILLED PADMOUNT TRANSFORMER NEAR BUILDING DOORWAYS AND/OR WINDOWED WALLS \_ \_ \_ \_ \_ EO-6242

INSTALLATION OF 13KV, 200A, URD PADMOUNTED DISCONNECT SWITCHGEAR (T-TAP BOX) \_ \_EO-14038-B

**CLEARANCE FOR PLANTING AROUND PADMOUNT EQUIPMENT**

CONSOLIDATED EDISON COMPANY OF N.Y., INC. DISTRIBUTION ENGINEERING DEPT

DATE 6/19/85 DWG. NO. **EO-16696-D** REV. 2  
 LAST REV. 9/25/18

FIELD MANUAL NO. 22 - URD. SECTION NO. 9: MISCELLANEOUS

CONST. STDS. MANUAL No. 3 SECTION 16 URD

COMPUTER GENERATED DRAWING NOT TO BE HAND REVISED

|                 |      |            |      |
|-----------------|------|------------|------|
| DRAWN BY        | DATE | CHECKED BY | DATE |
| DISCIPLINE CODE |      | SCALE      |      |
| APPROVED        |      |            |      |
| MGR.            |      | DATE       |      |
| MGR.            |      | DATE       |      |