
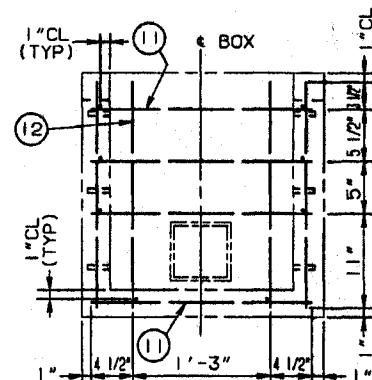
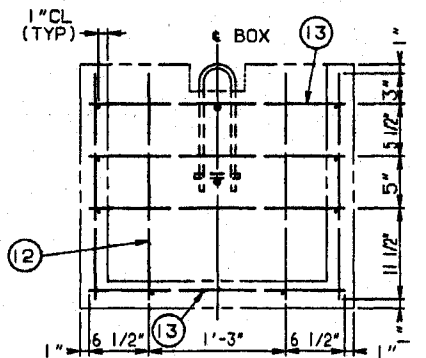
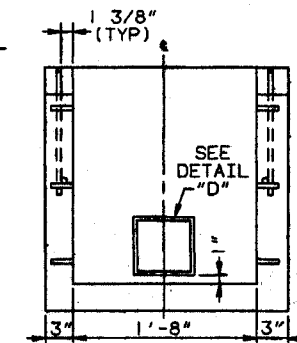
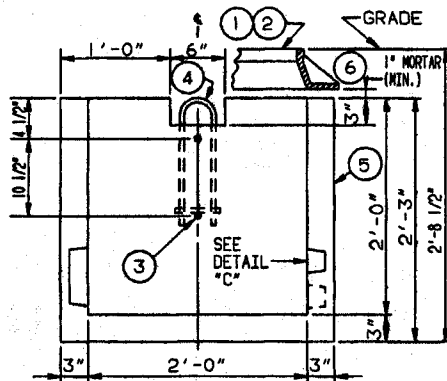
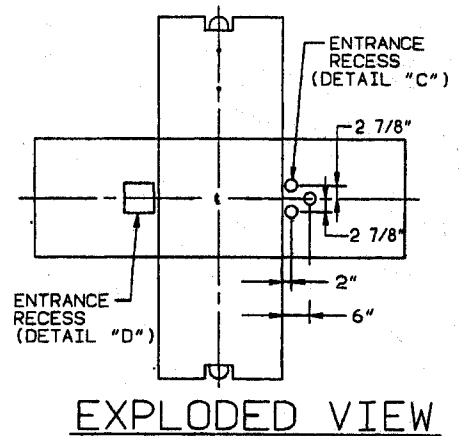




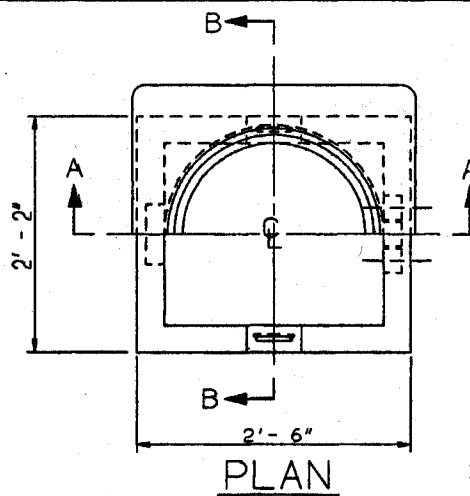

APPROX. WT. OF STEEL = 18 LBS.
APPROX. WT. OF CONCRETE = 850 LBS.

CONSTRUCTION SPECIFICATION:
REINFORCING BARS SHALL BE WIRE TIED AT ALL CONTACT POINTS.

INSTALLATION SPECIFICATION:
IN ROCK EXCAVATION INSTALL BOX ON 3" SAND CUSHION. GROUT LIFTING SLOTS AT TIME OF INSTALLATION.

MATERIAL SPECIFICATIONS:
ALL REINFORCING BARS SHALL BE BILLET STEEL, DEFORMED, AND SHALL CONFORM TO ASTM SPEC DES A615, GRADE 40.

REFERENCES:
PROPERTY LINE, SPLICE BOX REQUIREMENTS E0-6210

ITEM NO.	LOCATION	SIZE	LENGTH	QUANTITY	SHAPE
13	SIDE WALLS & FLOOR	# 3	2'-4"	8	STRAIGHT
12	END WALLS & SIDE WALLS	# 3	2'-1"	8	STRAIGHT
11	END WALLS & FLOOR	# 3	2'-0"	8	STRAIGHT

REINFORCEMENT SCHEDULE

* "ROAD SAFETY" TYPE PL-24 WITH LOCKING DEVICE (OR APPROVED EQUAL)

6	AS REQD	CEMENT MORTAR		E0-100,167
5	0.2 CU. YD	CONCRETE	CLASS II	E0-1008
4	2	LIFTING EYE	ITEM 8	E0-7841-C
3	2	3/8" INSERT		E0-100,133
2	1	MANHOLE COVER		"
1	1	MANHOLE FRAME		"
ITEM NO. QUANTITY		DESCRIPTION		DWG. OR SPEC. NO.

BILL OF MATERIAL

PL-24 CUSTOMER PROPERTY LINE BOX
PRECAST CONCRETE
2'-0" X 1'-8" X 2'-0"

CONSOLIDATED EDISON COMPANY OF N.Y. INC.
ELECTRICAL ENGINEERING DEPT.

DATE 5/13/86
LAST REV.

DWG. NO. E0-16736-BREV. 0