



E0-9522-B

REVISIONS


3/18/85	1	ADDED NOTES & UPDATED DWG. C.W. 2-19-85
9/1/86	2	CHG'D. NOTES & TITLE C.W. 4-11-86
10/13/88	3	CHG'D. NOTE 6 J.L. 10-7-88

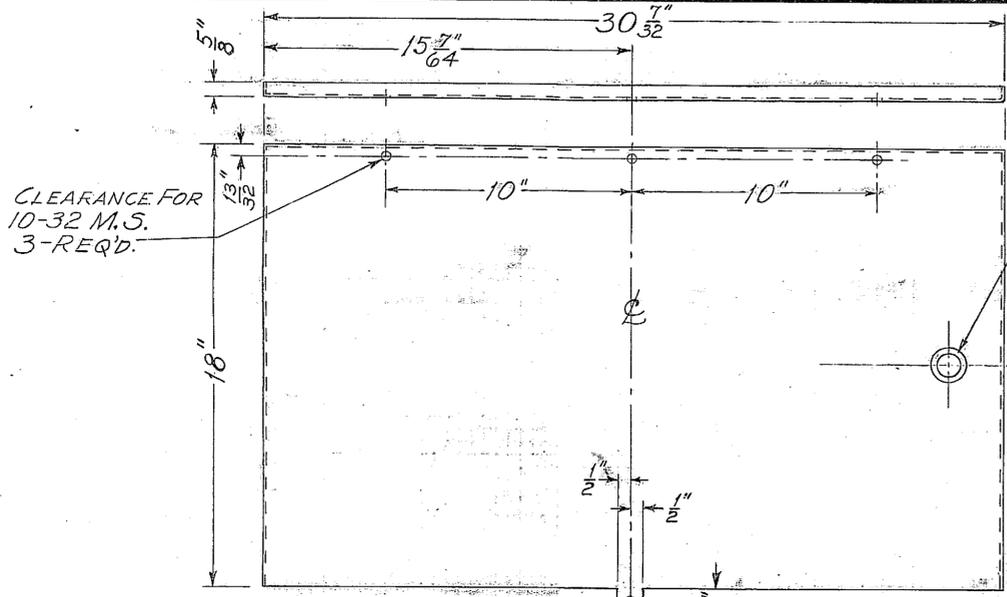

LOCKING DEVICE WITH SEALING FACILITIES 7/8" DIA. KNOCKOUT FOR BARREL LOCK ADAPTING BUSHING (SEE NOTE 6)

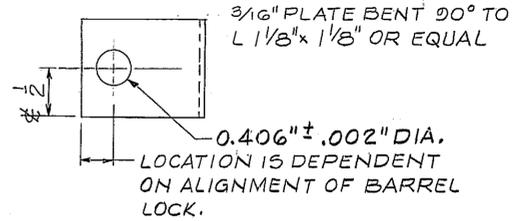

LOCK BRACKET

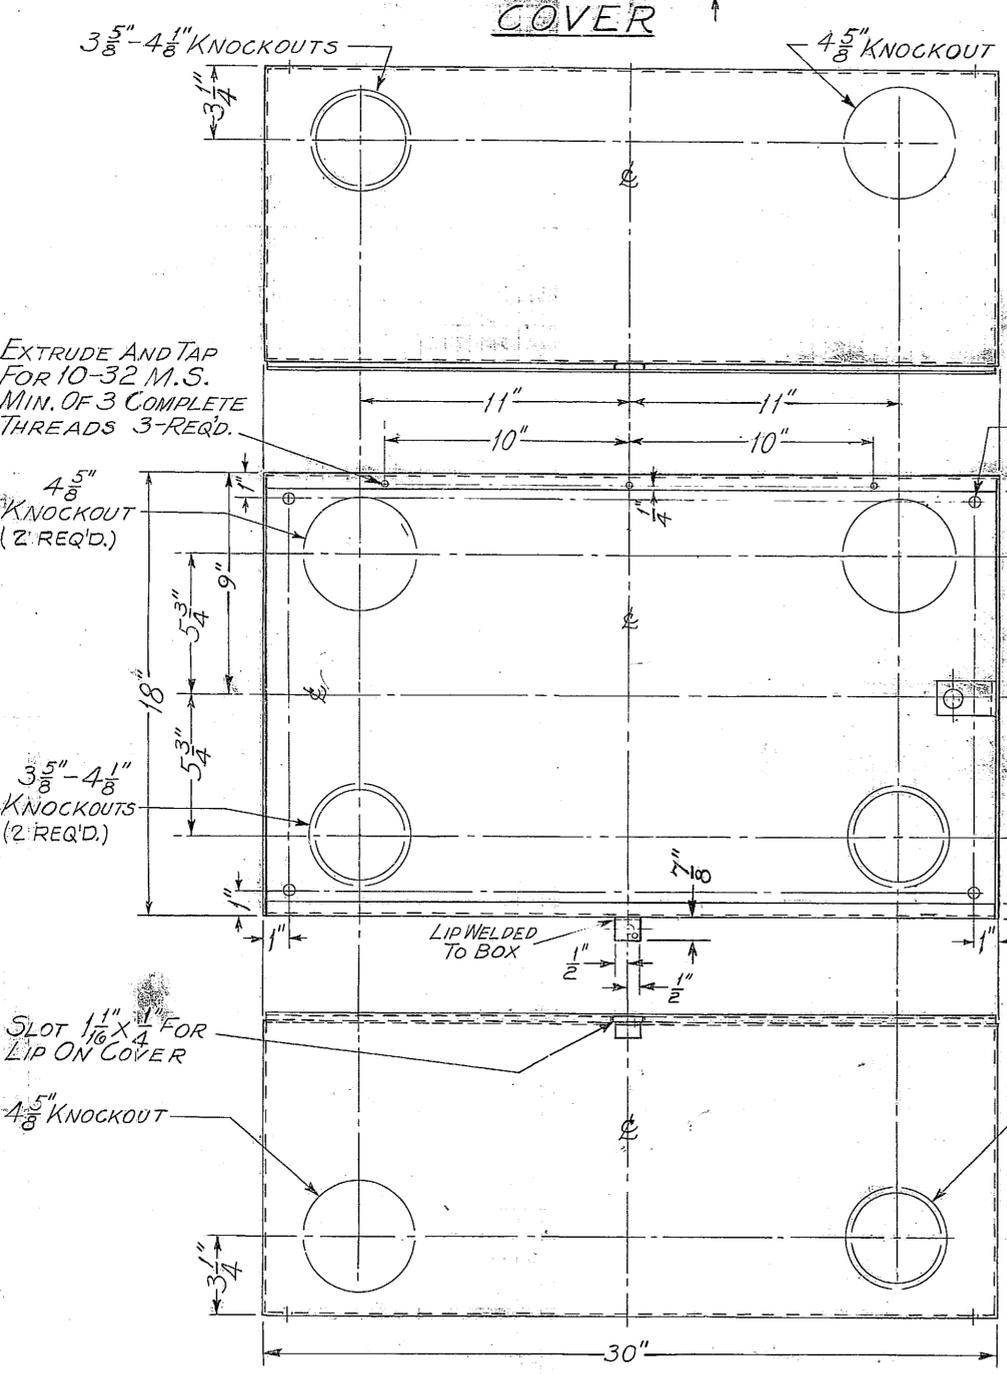

EXTRUDE AND TAP FOR 10-32 M.S. MIN. OF 3 COMPLETE THREADS 3-REQ'D.

SLOT 1 1/8 X 1/4 FOR LIP ON COVER

7 1/16" MOUNTING HOLES (4-REQ'D)

4 5/8" KNOCKOUT (1-REQ'D EACH SIDE)

LOCK BRACKET (SEE DETAIL) TACK WELD (MIN. 4) LOCATION IS DEPENDENT ON ALIGNMENT OF BARREL LOCK AND MFR'S. TYPE BARREL LOCK ADAPTING BUSHING.

3 5/8" - 4 1/8" KNOCKOUTS 1-REQ'D EACH SIDE

3 5/8" - 4 1/8" KNOCKOUTS

NOTES:

1. THE SERVICE END BOX COVER SHALL BE OF NO. 14 U.S. STANDARD GAUGE GALVANIZED SHEET STEEL AND HAVE A FINISH OF BAKED GRAY ENAMEL.
2. KNOCKOUT DIMENSIONS INDICATE ACTUAL DIAMETER OF KNOCKOUT AND NOT SIZE OF CONDUIT.
3. SEALING FACILITIES SHALL ACCOMMODATE STANDARD SEALS AND PADLOCK WITH 5/16" DIAMETER HASP.
4. FOR OUTDOOR TYPE A SERVICE END BOX AND COVER SHALL BE CONSTRUCTED AND DESIGNATED "RAINTIGHT."
5. A NAMEPLATE SHALL BE PLACED ON THE OUTSIDE OF THE COVER AND CONTAIN THE MANUFACTURER'S NAME AND CATALOG NUMBER.
6. FOR INDOOR ENCLOSURE USE HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE CATALOG NO. 93389000, HIGHFIELD MRG. CO., BRIDGEPORT, CONN. OR BROOKS LOCK GUARD, CATALOG NO. 86505, E. J. BROOKS CO., NEWARK, NEW JERSEY OR INNER-TITE LOCK HEAD PROTECTOR WITH SEALING FERRULE CATALOG NO. E-0090A, INNER-TITE CORP., SPRINGFIELD, NEW JERSEY. FOR OUTDOOR "RAINTIGHT" ENCLOSURES, USE HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE AND GASKETS CATALOG NO. 9338997 OR BROOKS LOCK GUARD CATALOG NO. 865150.
7. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS, THE DEPT. OF BUILDINGS OF THE CITY OF NEW YORK AND UNDERWRITERS LABORATORIES, INC. PUB. NO. 50.
8. SAMPLES OF THE EQUIPMENT SHALL BE SUBMITTED TO THE DISTRIBUTION INSTRUMENTATION ENGINEER FOR APPROVAL.

SERVICE END BOX FOR INDOOR OR OUTDOOR LOCATIONS 30" X 18" X 12"

CONSOLIDATED EDISON COMPANY OF N. Y., INC. ELECTRICAL ENGINEERING DEPT.

DATE MAR. 8, 1960 MES. NO. 484 REV. 3
LAST REV. 10-7-88

FIELD MANUAL # 4 SECTION NO. 6
FIELD MANUAL # 16 SECTION NO. 3

NO.	DATE	REVISIONS	APPROVED	FOR APPROVAL	DIV.	SIGNATURE	DATE	DRAWN BY	DATE	CHECKED BY	DATE
					E0-9522-B		C. U. Moore		3/2/60		
					ELECTRICAL ENGINEER		DATE				