

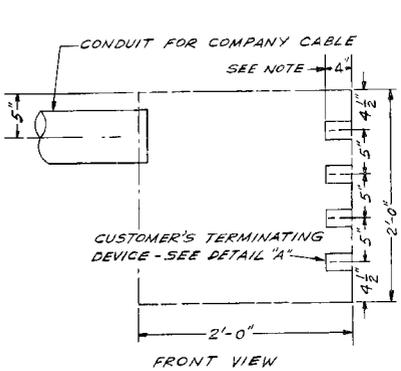
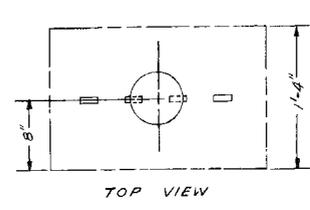
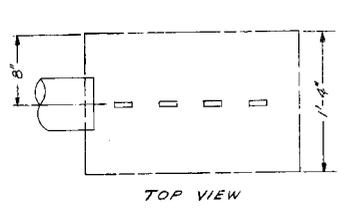



| REVISIONS | |
|-----------|--|
| 1 | CHG. TERMINAL DETAIL, ADDED 750 KCMIL AL. C.W. 2-18-70 |
| 2 | UPDATED, CHG. TITLE & FILING INFO. 5-24-85 |
| 3 | |
| 4 | |
| 5 | |
| 6 | ADDED RECOMMENDED STANDARD CABLE SIZES NOTE. REMOVED ALUMINUM FOR TERMINAL MATERIAL. CHANGED TERMINAL DEVICE THICKNESS FROM 1/4" TO 1/2" |
| 7 | ADDED SPECIAL NOTE |

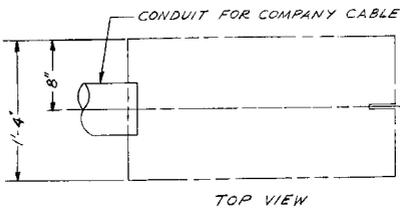


2'-0" HIGH X 2'-0" WIDE X 1'-4" DEEP SPACE COMPANY CABLES AT SIDE, CUSTOMER TERMINALS AT SIDE. ARRANGEMENT NO. 1

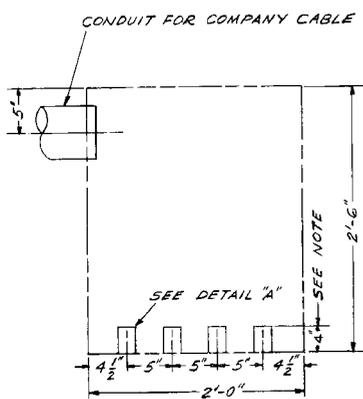


2'-0" HIGH X 2'-0" WIDE X 1'-4" DEEP SPACE COMPANY CABLES AT SIDE, CUSTOMER TERMINALS AT BOTTOM. ARRANGEMENT NO. 2

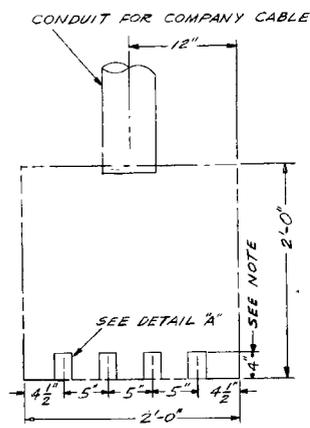

2'-0" HIGH X 2'-0" WIDE X 1'-4" DEEP SPACE COMPANY CABLES AT TOP, CUSTOMER TERMINALS AT BOTTOM. ARRANGEMENT NO. 3

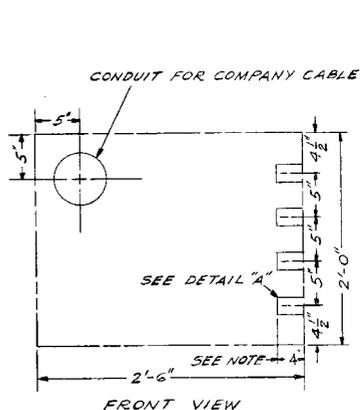

2'-0" HIGH X 2'-6" WIDE X 1'-4" DEEP SPACE COMPANY CABLES AT REAR, CUSTOMER TERMINALS AT BOTTOM. ARRANGEMENT NO. 4

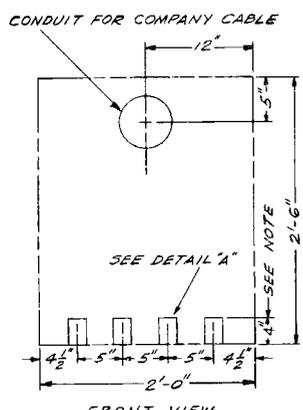


2'-0" HIGH X 2'-0" WIDE X 1'-4" DEEP SPACE COMPANY CABLES AT REAR, CUSTOMER TERMINALS AT BOTTOM. ARRANGEMENT NO. 5


SPECIAL NOTE:
THIS SPECIFICATION IS NOT TO BE USED FOR 265/460 - VOLT

NOTES:
THESE ARE MINIMUM REQUIREMENTS FOR CONNECTION OF COMPANY'S CABLES AND DO NOT COVER REQUIREMENTS FOR CUSTOMER'S CABLES.

- NO CUSTOMER CABLES SHALL OCCUPY SPACE IN AREA SHOWN INSIDE END BOXES.**
- A BOX ENCLOSING THE REQUIRED SPACE SHALL CONFORM TO THE FOLLOWING -
- 1 - BOX SHALL BE IDENTIFIED BY MANUFACTURER'S NAME.
 - 2 - BOX SHALL BE MADE OF GALVANIZED SHEET STEEL AND HAVE A FINISH OF GRAY ENAMEL.
 - 3 - THE GAUGE OF THE STEEL SHALL CONFORM WITH THE REQUIREMENTS OF THE UNDERWRITERS LABORATORIES INC.
 - 4 - FRONT COVER OF BOX SHALL BE SEALABLE.

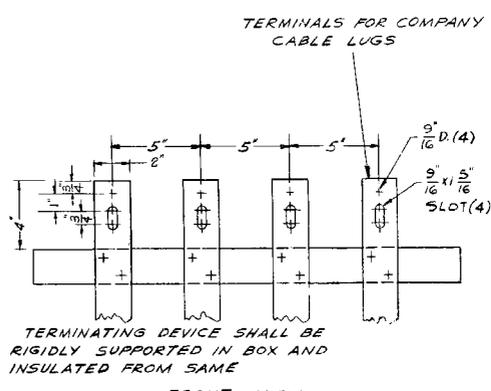

DETAIL 'A' - CUSTOMER'S TERMINATING DEVICE
4" LENGTH IS REQUIRED FOR CONNECTION OF LUGS.

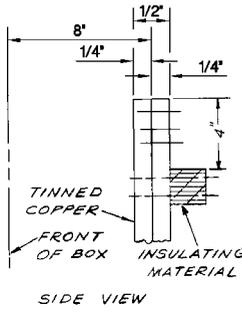

REF. DWGS:

| | |
|---|-----------|
| BUILDINGS WITH BASEMENTS AT PROPERTY LINE - EO-6208-D | |
| BUILDINGS WITH BASEMENTS BACK OF PROPERTY LINE - EO-6209-D | |
| BUILDINGS WITHOUT BASEMENTS AT PROPERTY LINE - EO-6211-D | |
| BUILDINGS WITHOUT BASEMENTS BACK OF PROPERTY LINE - EO-6212-D | |
| BUILDINGS WITH SUITABLE SUB-SIDEWALK SPACE | |
| OUTSIDE OF PROPERTY LINE | EO-6214-D |
| SPACE REQUIREMENTS - MAX 2-500KCMIL COPPER | |
| CABLES PER PHASE | EO-9072-B |
| SPACE REQUIREMENTS - MAX 3-500KCMIL COPPER | |
| CABLES PER PHASE | EO-9073-B |

RECOMMENDED STANDARD CABLE SIZES:

| | |
|--|--|
| COPPER - #6, #2, 2/0, 4/0, 500 KCMIL: CON EDISON | |
| #6, #2, 2/0, 4/0, 500 KCMIL, 600 KCMIL: CUSTOMER ONLY | |
| ALUMINUM - #4, 1/0, 4/0, 350 KCMIL, 2-350 KCMIL, 750 KCMIL, 900 KCMIL: CUSTOMER ONLY | |

CUSTOMER'S ELECTRIC SERVICE
SPACE REQUIREMENTS FOR COMPANY CABLES IN SERVICE
END BOXES ONE - 500KCMIL COPPER,
CON EDISON CABLES PER PHASE

CONSOLIDATED EDISON COMPANY OF N. Y., INC.

FIELD MANUALS
NO. 4 SERV INSTL
SECT 1 SERV UNDRND
NO. 16 SERV INSPECTRL
SECT 4-ELECT SERV
CONSTR STD'S
MANUAL NO. 3
SECT 3F SERV UNDRND