



EO-11263-B

REVISIONS	
Job 2-8-85	4
ADDED NOTES 11 & 12, LOCK BRACKET & UPDATE DWG.	
C.W. 1-29-85	

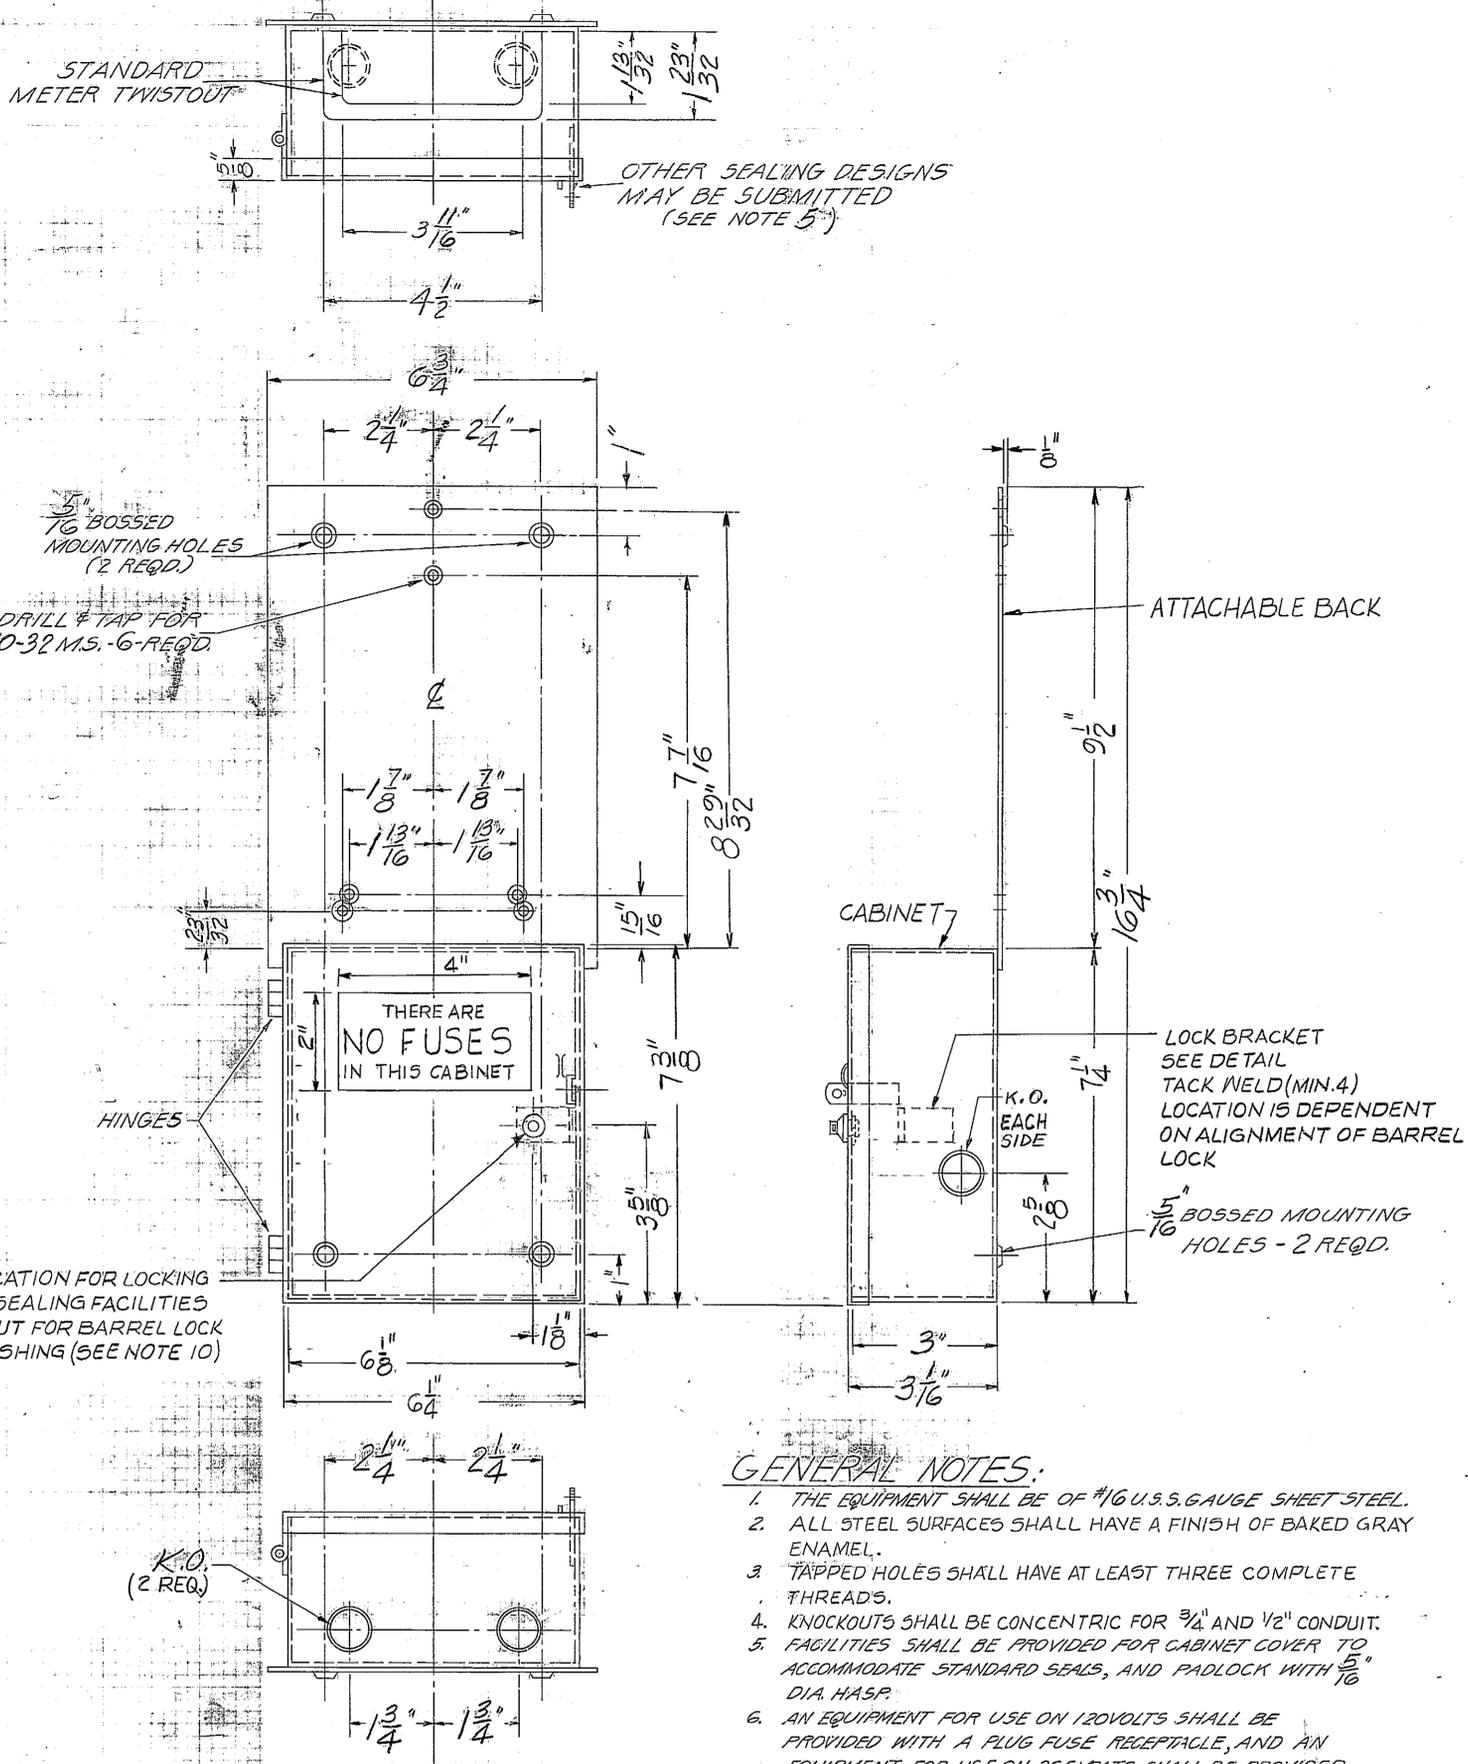

TYPICAL LOCATION FOR LOCKING DEVICE WITH SEALING FACILITIES
 3/8" DIA. KNOCKOUT FOR BARREL LOCK
 ADAPTING BUSHING (SEE NOTE 10)

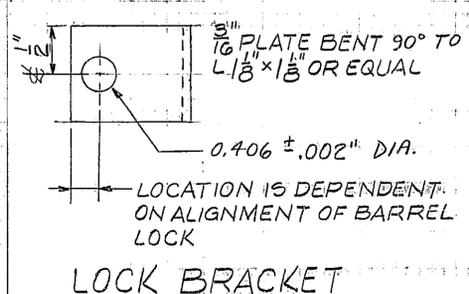

GENERAL NOTES:

1. THE EQUIPMENT SHALL BE OF #16 U.S.S. GAUGE SHEET STEEL.
2. ALL STEEL SURFACES SHALL HAVE A FINISH OF BAKED GRAY ENAMEL.
3. TAPPED HOLES SHALL HAVE AT LEAST THREE COMPLETE THREADS.
4. KNOCKOUTS SHALL BE CONCENTRIC FOR 3/4" AND 1/2" CONDUIT.
5. FACILITIES SHALL BE PROVIDED FOR CABINET COVER TO ACCOMMODATE STANDARD SEALS, AND PADLOCK WITH 5/16" DIA. HASP.
6. AN EQUIPMENT FOR USE ON 120VOLTS SHALL BE PROVIDED WITH A PLUG FUSE RECEPTACLE, AND AN EQUIPMENT FOR USE ON 265VOLTS SHALL BE PROVIDED WITH A LINK-TYPE DISCONNECT BLOCK MOUNTED ON AN INSULATED PAD EXTENDING 1" BEYOND TERMINALS.
7. CABINET DEPTH SHOWN IS FOR 120 VOLT EQUIPMENT. DEPTH MAY BE INCREASED FOR 265 VOLT EQUIPMENT WHERE REQUIRED TO PROVIDE PROPER CLEARANCE FOR THE DISC. LINK.
8. AN EQUIPMENT FOR USE ON 265VOLT CIRCUITS SHALL HAVE A DIFFERENT CATALOG NUMBER FROM THAT FOR USE ON 120VOLT CIRCUITS.
9. A NAMEPLATE SHALL BE ON THE OUTSIDE OF THE COVER AND CONTAIN MANUFACTURER'S NAME, CATALOG NO. AND VOLTAGE RATING.
10. HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE CAT. NO. 93389000 HIGHFIELD MFG. CO. BRIDGEPORT, CONN. OR BROOKS BARREL LOCK GUARD NO. 86505, EJ BROOKS CO. NEWARK, NEW JERSEY.
11. SAMPLES OF THE EQUIPMENT SHALL BE SUBMITTED TO THE DISTRIBUTION INSTRUMENTATION ENGINEER FOR APPROVAL.
12. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS AND THE DEPARTMENT OF PUBLIC WORKS OF THE CITY OF NEW YORK. MANUFACTURER SHALL OBTAIN UNDERWRITERS LABORATORIES APPROVAL.

FIELD MANUAL #4
 SECT. 6
 FIELD MANUAL #16
 SECT. 3

NO.	DATE	REVISIONS
3	4/15/63	ADDED MTG. HOLES - KNOCKOUT NOTE # NAME PLATE NOTE - CHANGED NOTE 3 # DIMENSIONS - REDRAWN.
2	1/14/64	CHANGE MTG. HOLES # NOTES.
1	1/16/68	CHANGED MTG. HOLES # BACK PLATE POSITION.

MOUNTING EQUIPMENT FOR INDICATING OR CUMULATIVE DEMAND METER EQUIPMENT

CONSOLIDATED EDISON COMPANY OF N. Y., INC.
 ELECTRICAL ENGINEERING DEPT.

DATE 6-15-38 SPEC. NO. 151 REV. 4
 LAST REV. 1-29-85

TRIM LINE

THIS DWG. SUPERSEDES DWG. NO. UB-11544

NO.	DATE	REVISIONS	APPROVED	DIV.	SIGNATURE	DATE	DRAWN BY	DATE	CHECKED BY	DATE
3	4/15/63	ADDED MTG. HOLES - KNOCKOUT NOTE # NAME PLATE NOTE - CHANGED NOTE 3 # DIMENSIONS - REDRAWN.					A. RUBINACCI	2-15-63		
2	1/14/64	CHANGE MTG. HOLES # NOTES.								
1	1/16/68	CHANGED MTG. HOLES # BACK PLATE POSITION.								

DESIGN ENGINEER: [Signature] DATE: 1/31/85
 DIST. INSTR. ENGR. DATE: 6/27/83

TRIM LINE