


EO-13817-D

REVISIONS


M. BALDWIN 8/30/99 1

REDRAWN TO
AUTOCAD CHG'D.
FILING INFO.
& ADDED NOTE
C.W 8/30/99

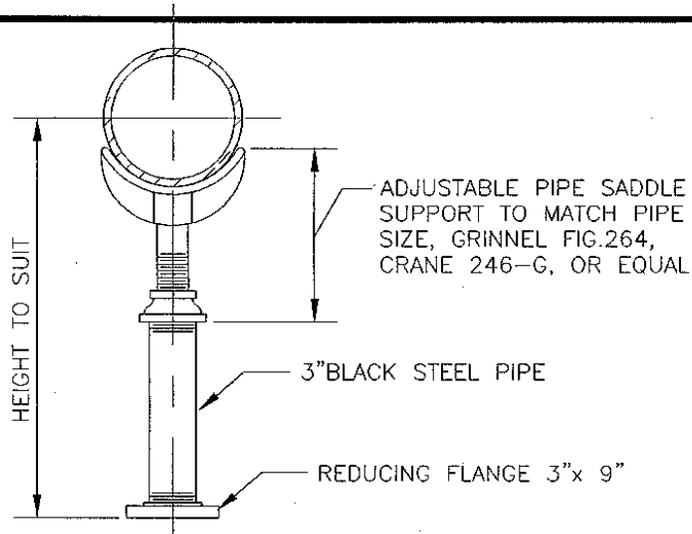

PIPE STAND

(SEE DETAIL BELOW FOR EQUIVALENT CONSTRUCTION)

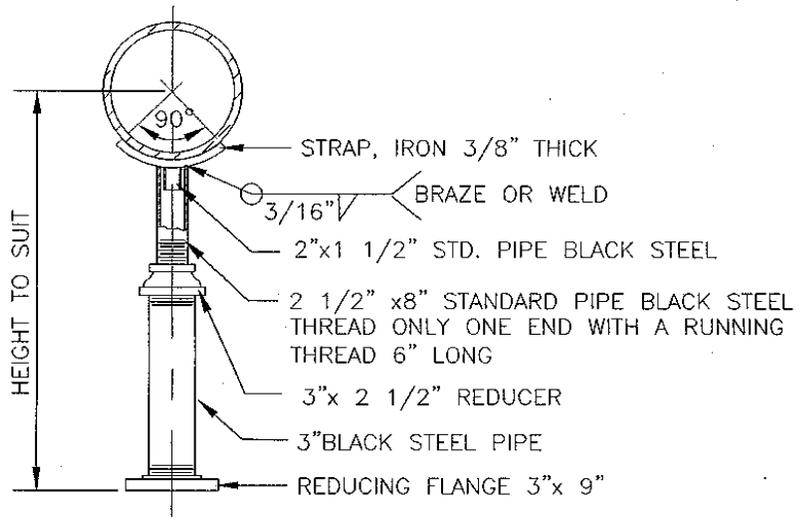

"DETAIL"

NOTE:

INSULATING MATERIAL MUST BE INSTALLED
BETWEEN THE PIPE SUPPORTS AND THE PIPE,
SO THAT THE PIPE NEVER MAKES CONTACT
WITH THE PIPE SUPPORT.

METERING
MANUAL
NO.3

**TYPICAL PIPE STAND DETAILS
FOR USE IN GAS METER AND
GAS SERVICE REGULATOR
INSTALLATIONS**

CONSOLIDATED EDISON COMPANY OF N.Y., INC.
GAS OPERATIONS DEPARTMENT

DATE 5/1/70 DWG. NO. G-639 REV. 1
LAST REV. 8/30/99