
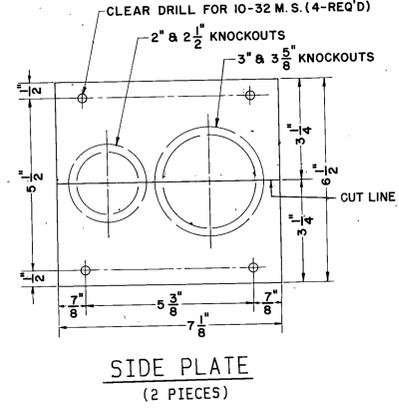
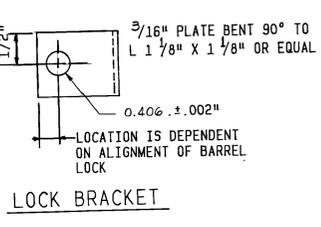


REVISIONS

2-8-73	1	ADDED NOTES & UPDATED DWG.
2-14-85	2	CHG'D. NOTE 4
9-20-88	3	

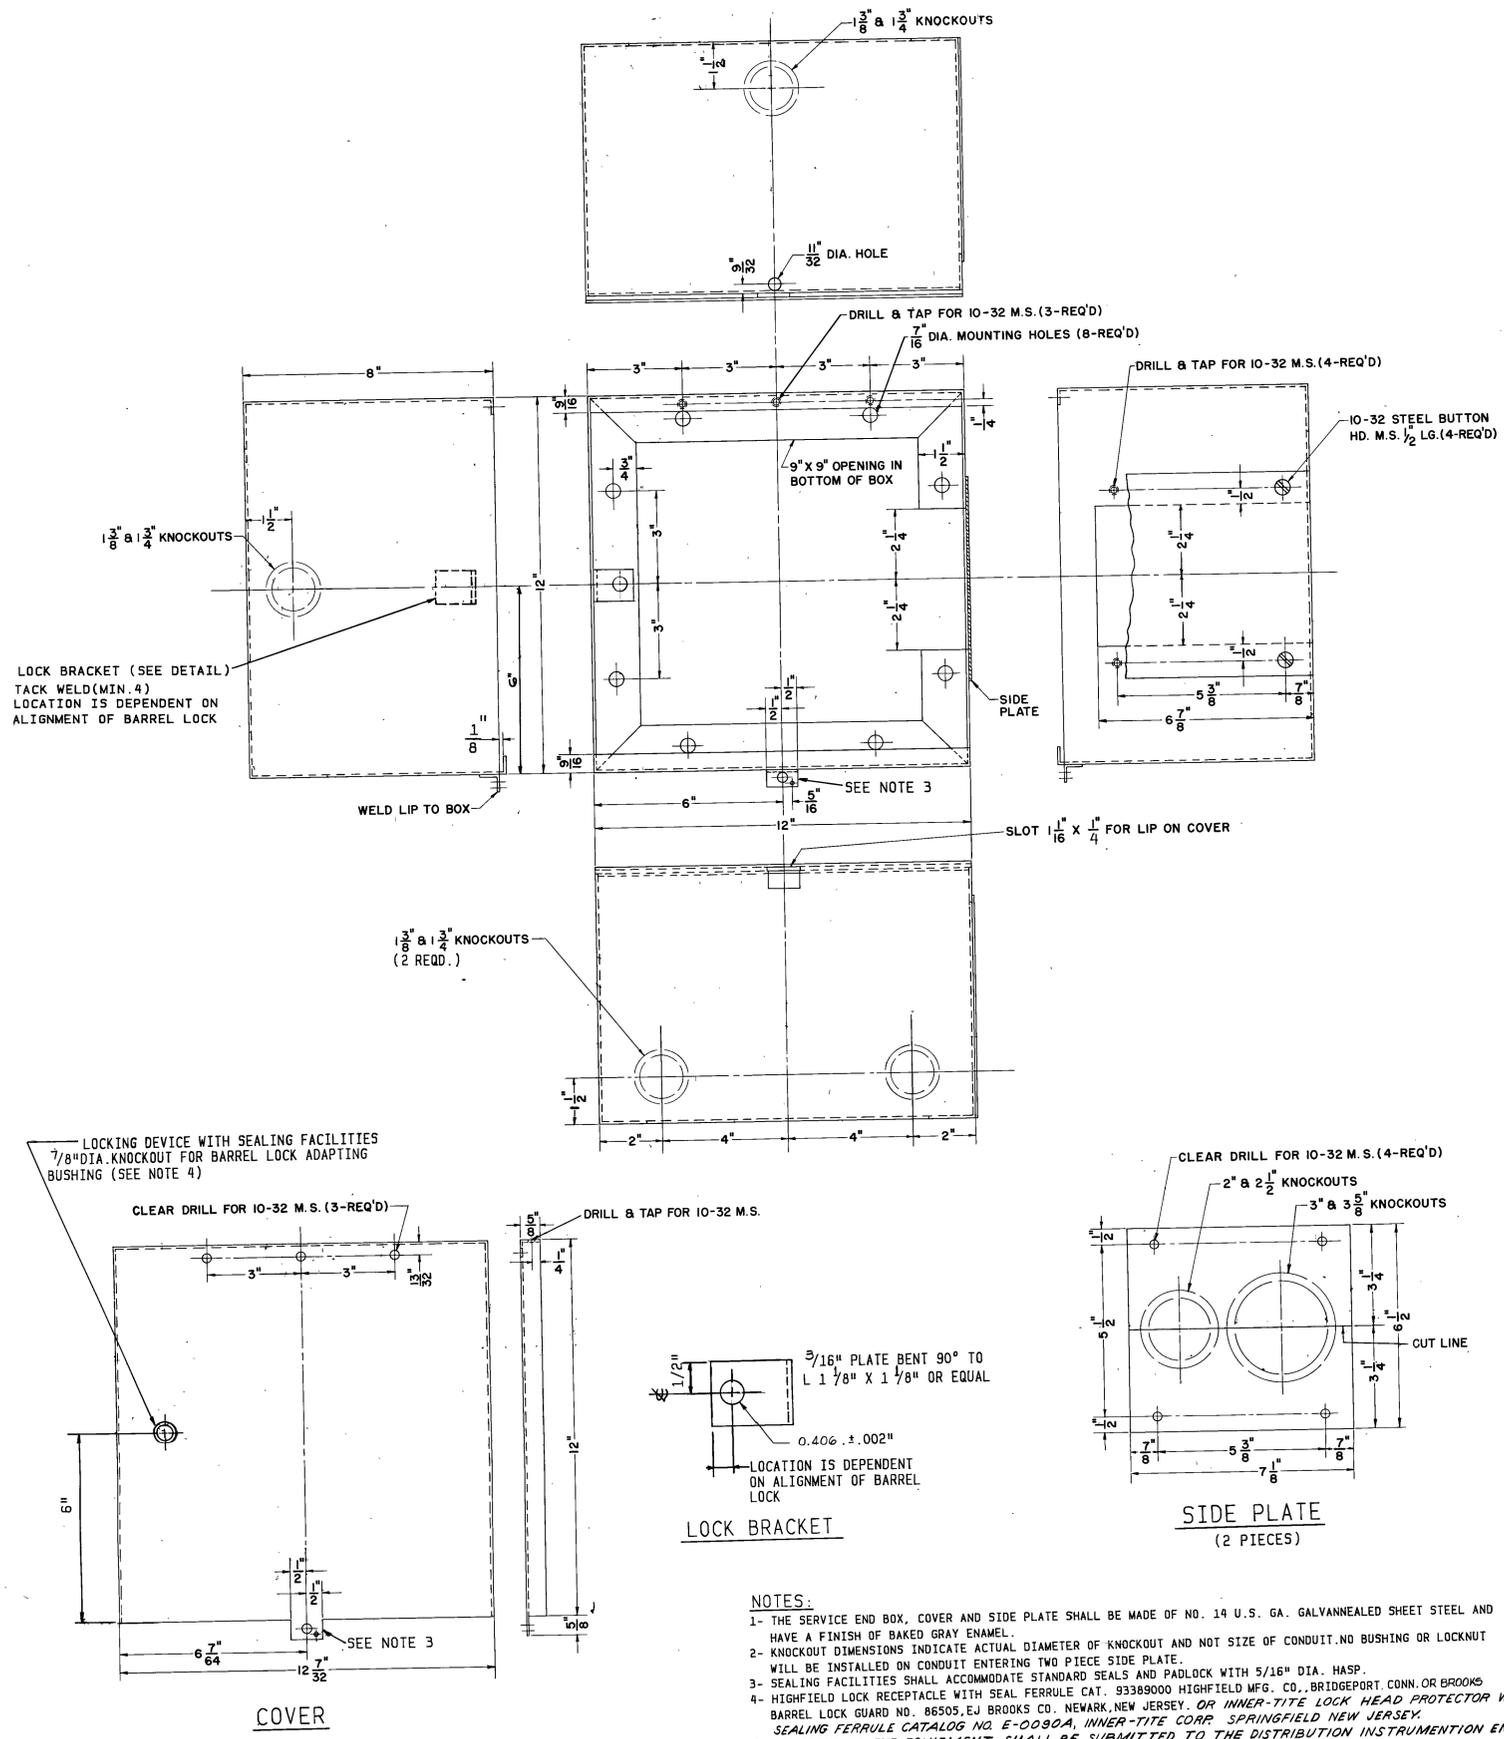

- NOTES:**
- 1- THE SERVICE END BOX, COVER AND SIDE PLATE SHALL BE MADE OF NO. 14 U.S. GA. GALVANNEALED SHEET STEEL AND HAVE A FINISH OF BAKED GRAY ENAMEL.
 - 2- KNOCKOUT DIMENSIONS INDICATE ACTUAL DIAMETER OF KNOCKOUT AND NOT SIZE OF CONDUIT. NO BUSHING OR LOCKNUT WILL BE INSTALLED ON CONDUIT ENTERING TWO PIECE SIDE PLATE.
 - 3- SEALING FACILITIES SHALL ACCOMMODATE STANDARD SEALS AND PADLOCK WITH 5/16\"/>

THIS DWG. SUPERSEDES DWG. U-A-27048

SERVICE END BOX FOR INDOOR
CO-OCCUPIED SERVICE PIPE 12\"/>

CONSOLIDATED EDISON COMPANY OF N. Y., INC.
ELECTRICAL ENGINEERING DEPT.

DATE 1-25-74	MES 400	REV. 2
LAST REV. 9-20-88	No.	

FIELD MANUAL #16
SECTION 3
FIELD MANUAL #4
SECTION 6

FOR APPROVAL	DIV.	SIGNATURE	DATE	DRAGN BY	DATE	CHECKED BY	DATE
				DIRCO	1-25-74	SABOL	1-28-74

EO-15406-A

TRIM LINE

2/22/74