


84889-07
 P. Haus 1/10/83
REVISIONS
 10/6/84 1
 ADDED ADDITIONAL
 1/4"-20 HOLES
 N.E.S. 8 11-12-84
 J. Signorilli 1/26/85 2
 CHGD. NOTES 6, 7 &
 LOCK BRACKET.
 ADDED NOTE 8
 J.L. 6-17-85

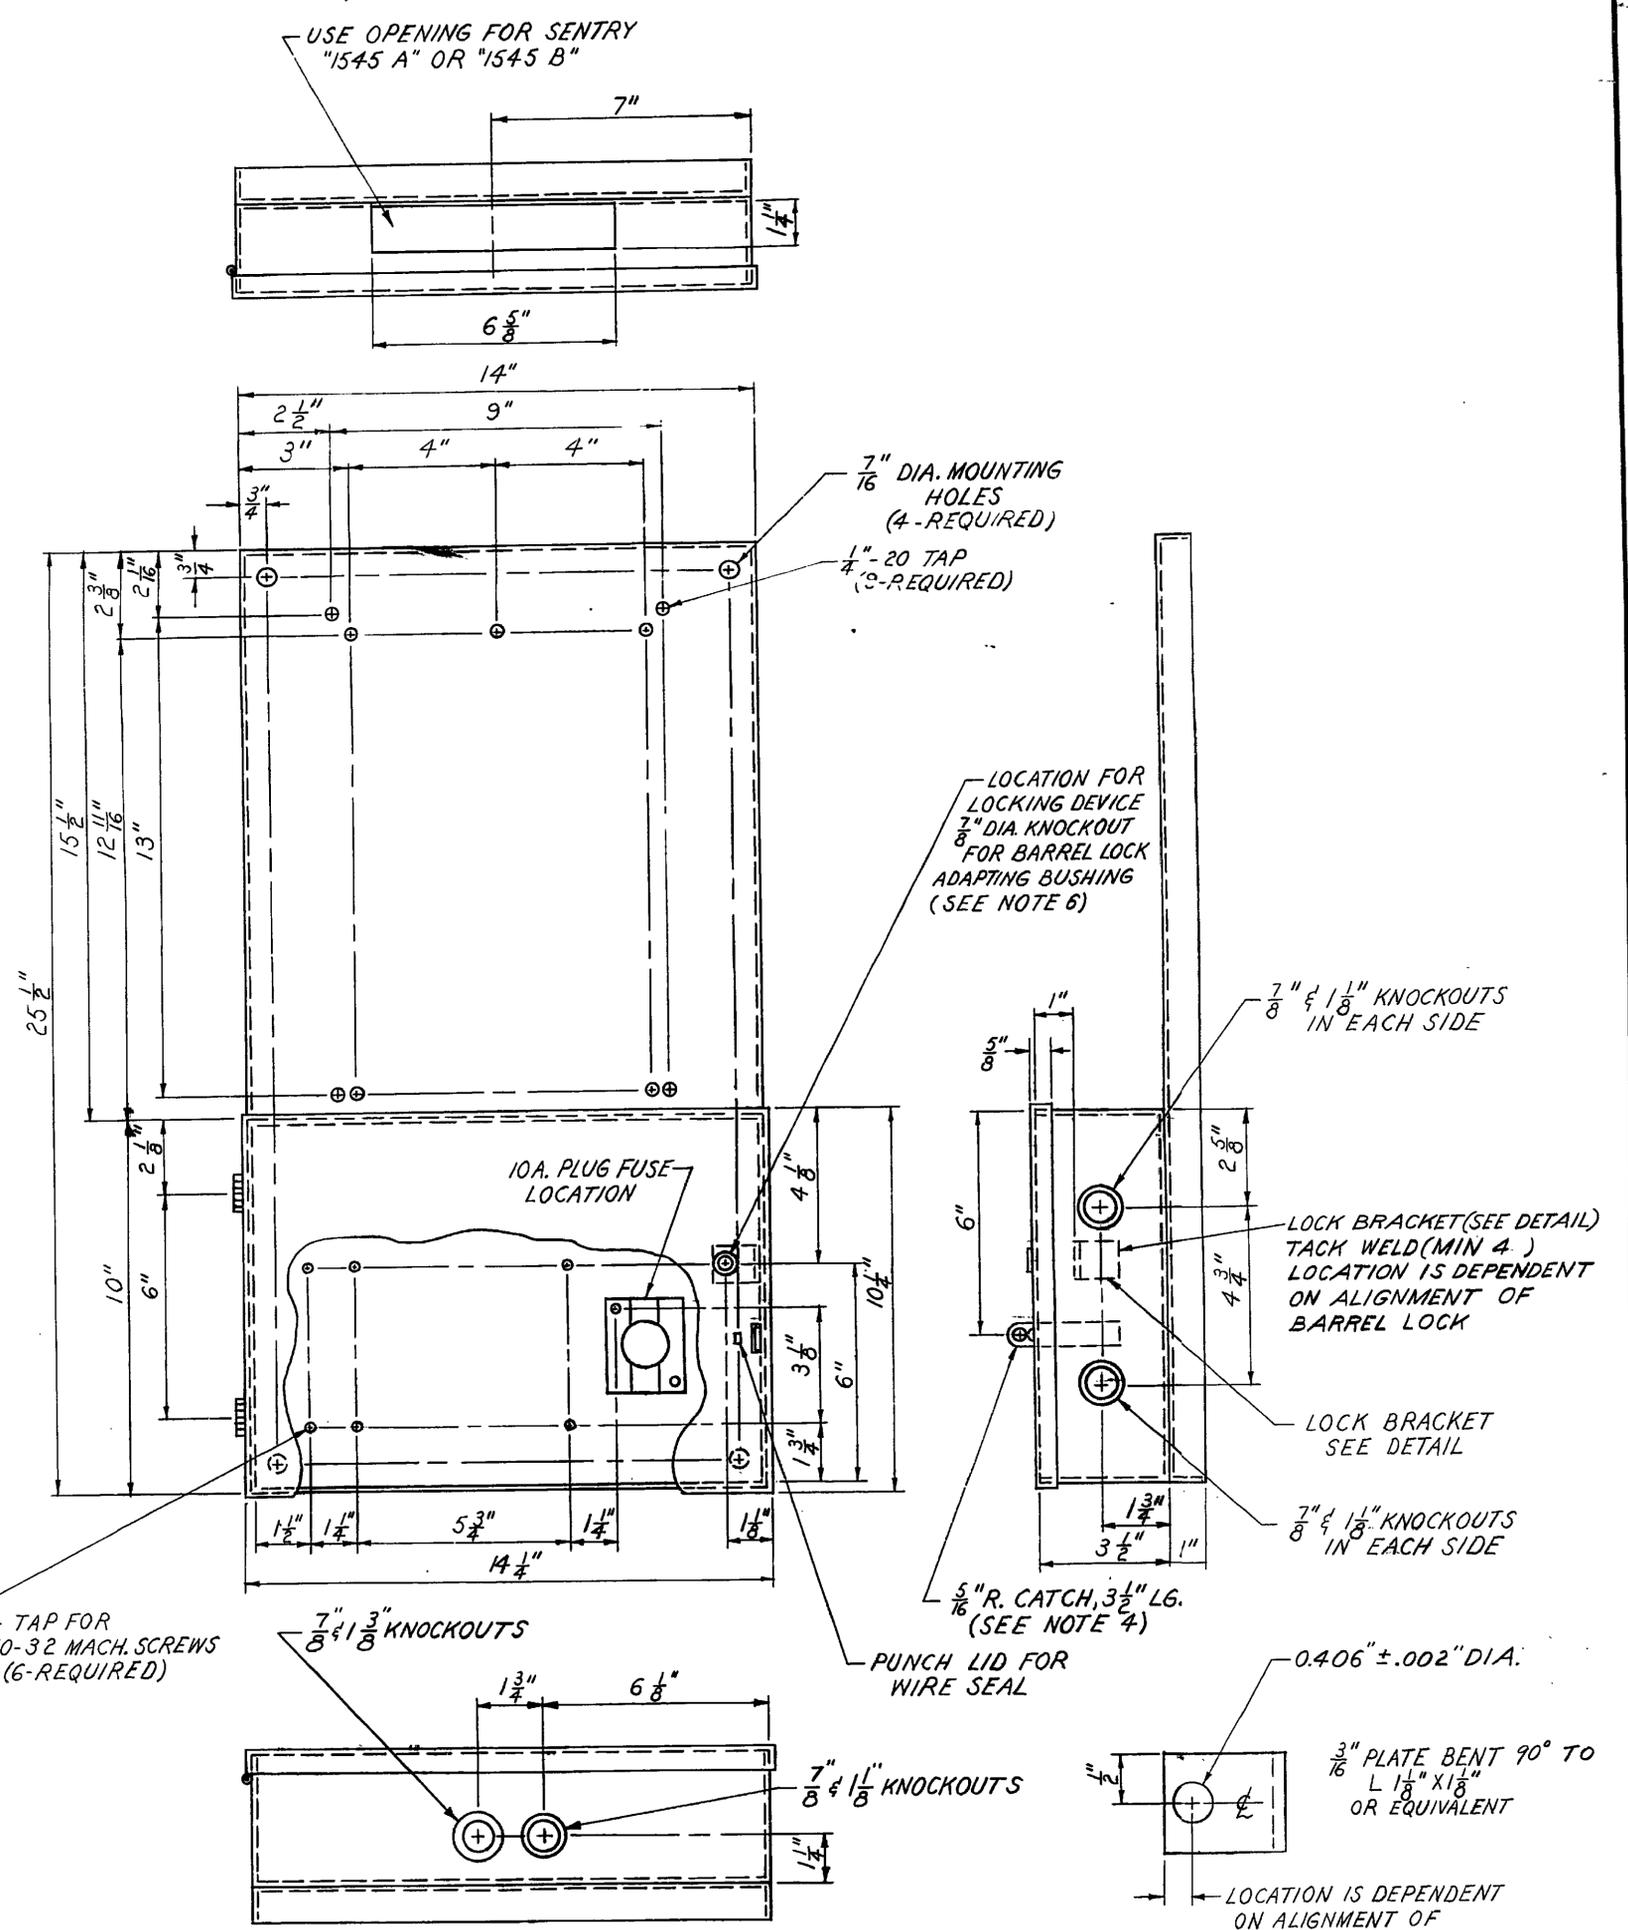

- NOTES:**
1. THE CABINET SHALL BE OF NO.14 U.S.S. GAUGE, AND THE BACK PLATE OF NO.12 U.S.S. GAUGE SHEET STEEL.
 2. UNLESS OTHERWISE SPECIFIED TOLERANCE ON HORIZONTAL TAPPED HOLES TO BE $\pm .010$ ", AND ARE TO HAVE AT LEAST THREE COMPLETE THREADS.
 3. ALL STEEL SURFACES SHALL HAVE A PROTECTIVE COATING OF GRAY ENAMEL, A.C.HORN CO. NO.1614, SHERWIN-WILLIAMS CO. NO.18076, OR DEVOE & REYNOLDS CO. NO.21.
 4. CABINET DOOR SHALL BE PROVIDED WITH CATCH AND FACILITIES TO ACCOMMODATE STANDARD SEALS AND PADLOCK WITH $5/16$ " DIA. HASP.
 5. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS, AND THE DEPARTMENT OF PUBLIC WORKS OF THE CITY OF NEW YORK.
 6. HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE, CAT. NO. 9338900, HIGHFIELD MFG. CO., BRIDGEPORT, CONN. OR BROOKS BARREL LOCK GUARD CAT. NO. 86505, E.J. BROOKS CO., NEWARK N.J. THE LOCKING DEVICE AND LOCK BRACKET SHALL BE PROPERLY ALIGNED TO RECEIVE A UTILITY BARREL LOCK.
 7. SAMPLES OF THE CABINET SHALL BE SUBMITTED TO THE DISTRIBUTION INSTRUMENTATION ENGINEER FOR APPROVAL.
 8. A NAMEPLATE SHALL BE ON THE OUTSIDE OF THE ENCLOSURE AND CONTAIN MANUFACTURER'S NAME AND CATALOG NO.

LOCK BRACKET

MOUNTING EQUIPMENT 14" X 25 1/2" FOR DEMAND METERING DEVICES

CONSOLIDATED EDISON COMPANY OF N. Y., INC.
 ELECTRICAL ENGINEERING DEPT.

DATE 10-26-82 SPEC. NO. 108-A REV. 2
 LAST REV. 6-17-85

FIELD MANUALS
 NO.4 SERV. INSTL.
 SECT.6: METER INSTL.
 NO.16 SERV. INSR
 CONTROL
 SECT.3: ELECT. METERING

TRIM LINE

NO.	DATE	REVISIONS	APPROVED	DIV.	SIGNATURE	DATE	DRAWN BY	DATE	CHECKED BY	DATE

DWG. NO. 'EO-16589-B, REV. 1

1/7/83

SCALE 3/8"=1"

DATE 1/7/83

DATE

DATE