
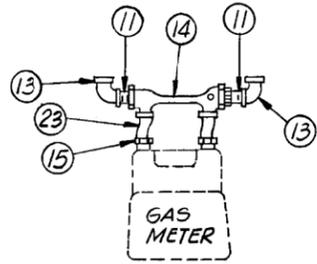



EO-16886-B

REVISIONS

- ROY WILLIAMS 8/11/95 1
UPDATED DWG.
ADDED NOTE h
C.W. 6-13-95
- M. BALDOVIN 4/7/99 2
UPDATED DWG.
ADDED NOTE (i)
C.W. 4/7/99

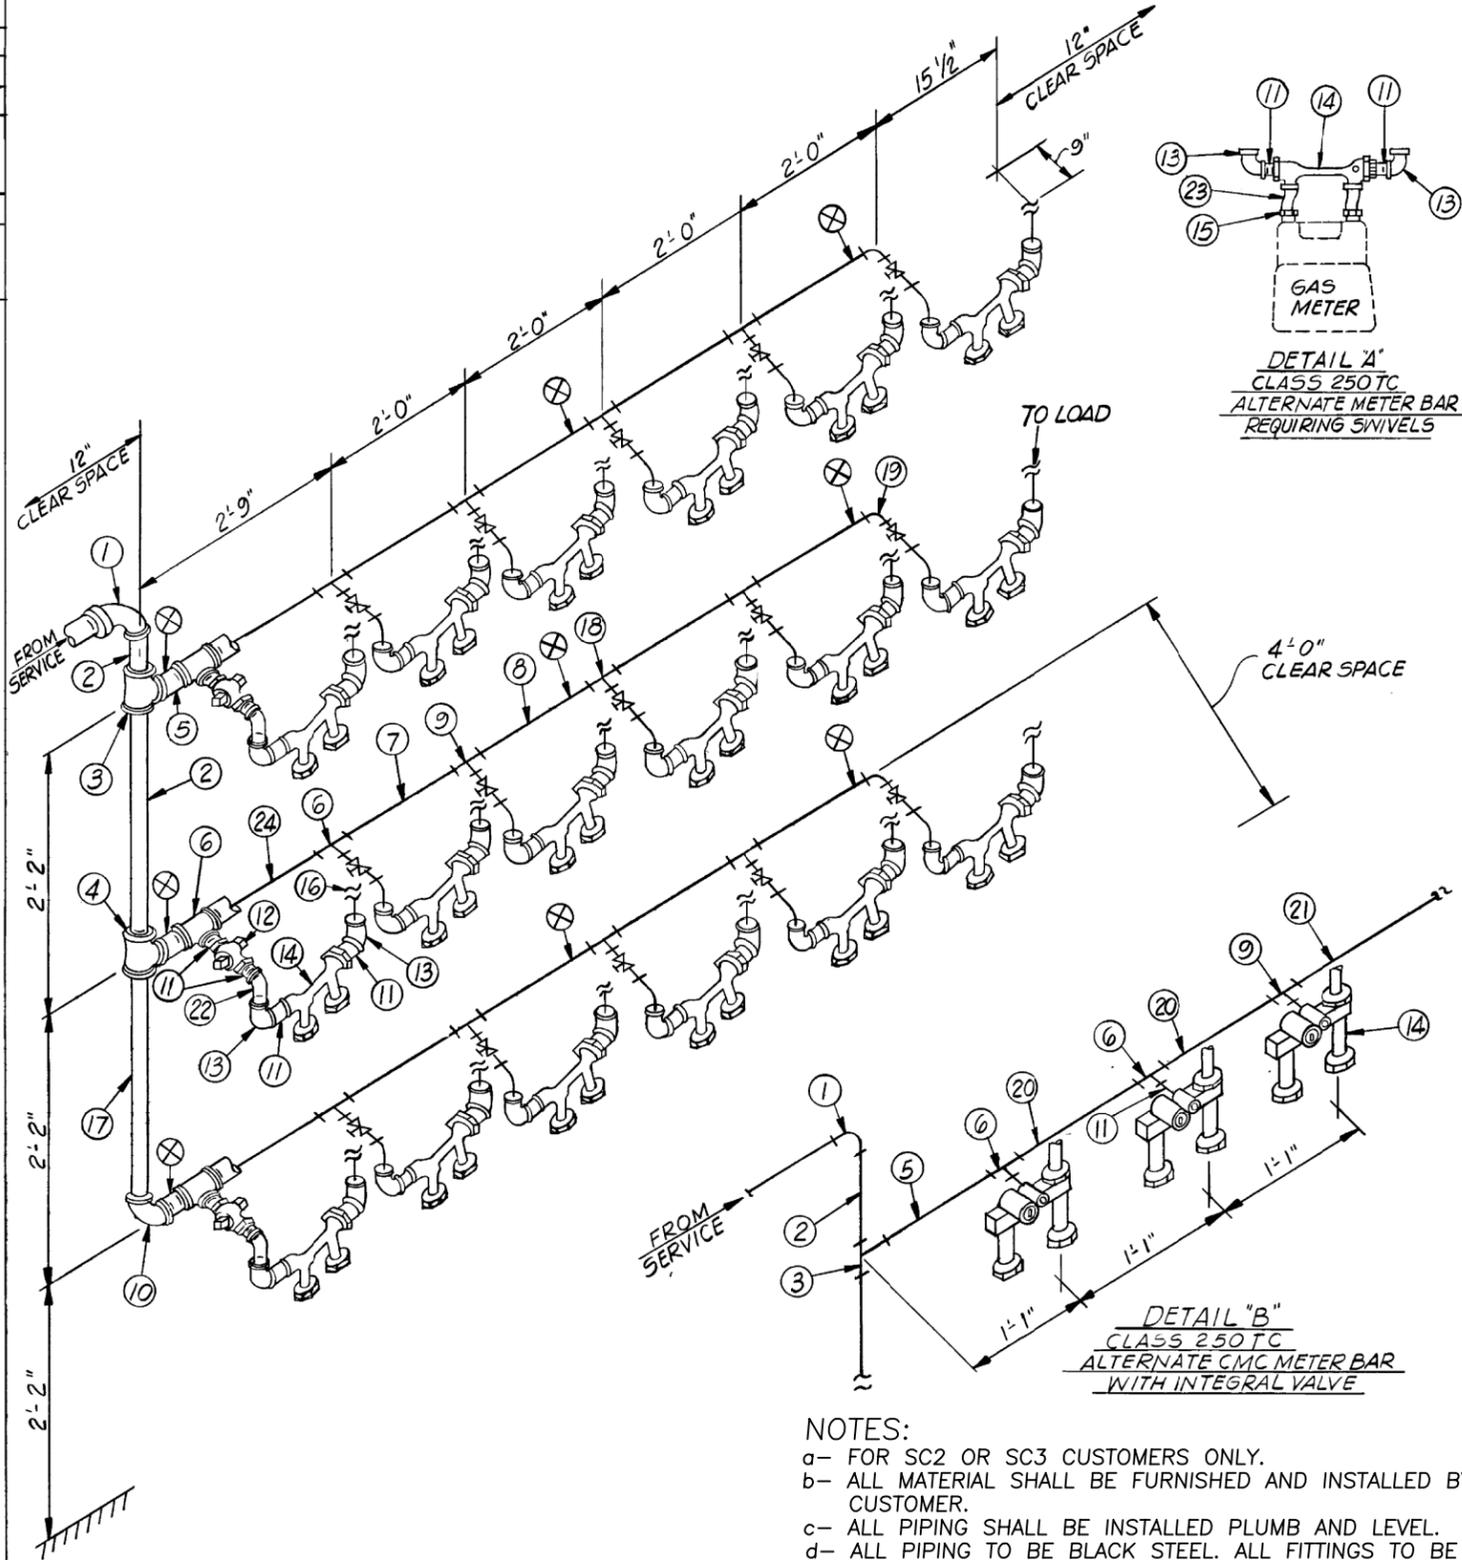

DETAIL A
CLASS 250TC
ALTERNATE METER BAR
REQUIRING SWIVELS

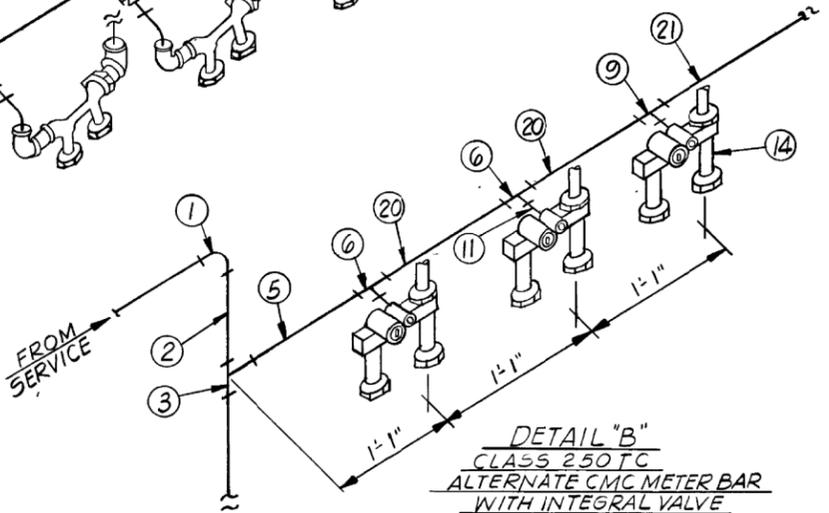

DETAIL B
CLASS 250TC
ALTERNATE CMC METER BAR
WITH INTEGRAL VALVE

NOTES:

- a- FOR SC2 OR SC3 CUSTOMERS ONLY.
- b- ALL MATERIAL SHALL BE FURNISHED AND INSTALLED BY CUSTOMER.
- c- ALL PIPING SHALL BE INSTALLED PLUMB AND LEVEL.
- d- ALL PIPING TO BE BLACK STEEL. ALL FITTINGS TO BE 150 LB. BLACK MALLEABLE IRON.
- e- WHERE SERVICE PIPE IS BURIED STEEL, INSTALL INSULATING COUPLING BETWEEN SERVICE HEAD VALVE AND METER.
- f- FOR EACH METER LESS THAN 6 ALONG A HORIZONTAL ROW REDUCTION FROM 2" TO 1 1/2" PIPE CAN BE MOVED ONE METER SET CLOSER TO VERTICAL HEADER.
- g- FOR MORE THAN 6 METERS ALONG A HORIZONTAL ROW, CONSULT WITH GAS MEASUREMENT FOR ADEQUATE PIPE SIZING.
- h- PIPING MUST BE LEFT PLUGGED BY CONTRACTOR PRIOR TO METER INSTALLATION.
- i- FOR LOW PRESSURE GAS SERVICE INSTALLATION, INSTALL AN INSULATED COMPRESSION COUPLING WITH 1/8" THREADED PLUG NEAR THE HEAD OF SERVICE.

⊗ INSTALL PIPE SUPPORTS WHERE INDICATED.

* SEE "REQUIREMENTS FOR GAS SERVICE INSTALLATION" BOOK.

24	PIPE	2" x 19"	
23	SWIVEL * (NOT REQ'D. WITH CMC)	1" x 20LT.	
22	ELBOW, 90°, STREET	1"	
21	NIPPLE	1 1/2" x 9"	
20	NIPPLE	2" x 9"	
19	ELBOW, 90°, RED.	1 1/2" x 1"	
18	TEE, RED.	1 1/2" x 1 1/2" x 1"	
17	PIPE	2"	
16	PIPE	1"	
15	SWIVEL CAP * (NOT REQ'D. WITH CMC)	20LT.	
14	METER BAR *	ALTERNATE CMC METER BAR WITH INTEGRAL VALVE	1" x 1" x 20LT.
		CMC BAR	1" x 1" x 20LT.
		ALTERNATE	1" x 1" x 1"
13	ELBOW, 90°	1"	
12	METER VALVE * NOT REQ'D. WITH ALTERNATE CMC BAR	1"	
11	NIPPLE	1" x 2"	
10	ELBOW, 90°	2"	
9	TEE, RED.	2" x 1 1/2" x 1"	
8	PIPE	1 1/2" x 2 1"	
7	PIPE	2" x 2 1"	
6	TEE, RED.	2" x 2" x 1"	
5	NIPPLE	2" x 6"	
4	TEE, RED.	3" x 2" x 2"	
3	TEE, RED.	3" x 3" x 2"	
2	PIPE	3"	
1	ELBOW, 90° REDUCING FROM SERVICE EXTENSION SIZE TO:	3"	

ITEM NO.	DESCRIPTION	SIZE
BILL OF MATERIAL		

METERING SPECIFICATIONS & PROCEDURES VOLUME NO. 3
MAILING LIST 3

INSTALLATION OF MULTIPLE CLASS 250TC GAS METER SETS - INDOORS

CONSOLIDATED EDISON COMPANY OF N. Y., INC.
GAS OPERATIONS DEPARTMENT

DATE: 8-14-89
LAST REV. 4/7/99

DWG. NO. **EO-16886-BREV. 2**

NO.	DATE	REVISIONS	APPROVED	FOR APPROVAL	DIV	SIGNATURE	DATE	DRAWN BY	DATE	CHECKED BY	DATE	SCALE
								DIRICO	8-14-89			
								Charles F. ...	9/7/89			
								Charles F. ...	9/13/89			