

REVISIONS

G. LUDWIG DATE 01/07/14	0
NEW DRAWING	
H.T 01/07/14	
G. LUDWIG DATE 11/16/22	1
UPDATED DRAWING ADDED TABLES & NOTES	
S.P DATE 11/16/22	

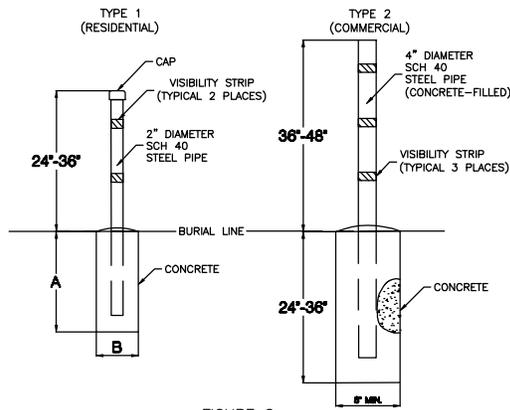


FIGURE 2

TABLE 1 - DIMENSIONS FOR CONCRETE FOOTING

A (INCHES)	B (INCHES)
12	8
15	8
20	6

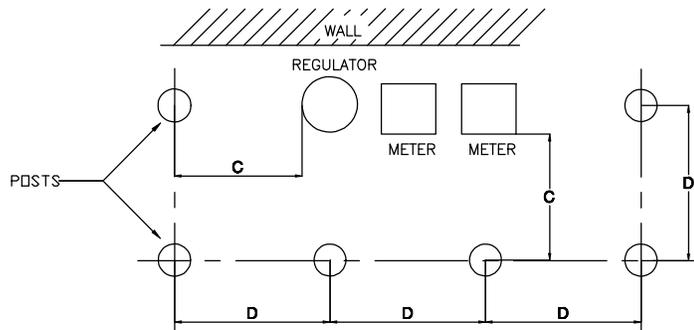


FIGURE 3

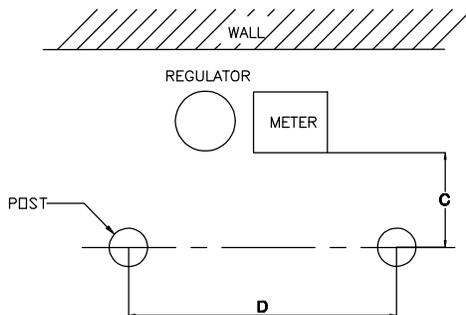


FIGURE 3

SINGLE METER POST ARRANGEMENT

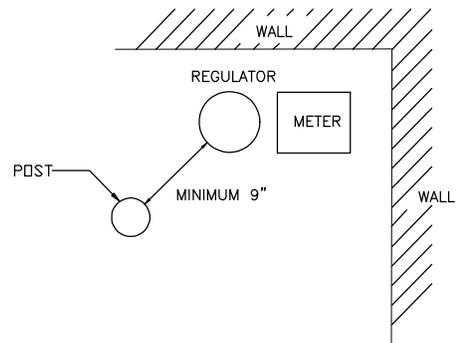


FIGURE 4

SINGLE POST ARRANGEMENT

TABLE 2 - DIMENSIONS FOR POST ARRANGEMENT

C ¹ (INCHES)	MAXIMUM D ² (INCHES)
LESS THAN 12	SPACE POSTS TO PREVENT VEHICLE FROM CONTACTING METER SET BUT LEAVING ROOM FOR METER ACCESS AND MAINTENANCE.
12	18
15	24
18	30
24	42

1. DISTANCE TO METER OR REGULATOR.
2. MAY NOT BE MORE THAN 42".

BUMPER INSTALLATION

CONSOLIDATED EDISON COMPANY OF N.Y., INC.
GAS ENGINEERING DEPT

DATE 01/07/14 DWG. NO. 502163 REV.1
LAST REV. 11/16/22