


EO-7421-B

REVISIONS

G. LUDWIG	19
DELETED CL-500 & CL-1000 METER DETAILS. REVISED BILL OF MATERIAL. DELETED ALTERNATE METER BAR DETAIL. REVISED TITLE. G.Y. 8-7-15	
G. LUDWIG	6/01/16 20
REVISED DESC. OF ITEM 12, ADDED NOTE "G"	
D.T.	5/24/16

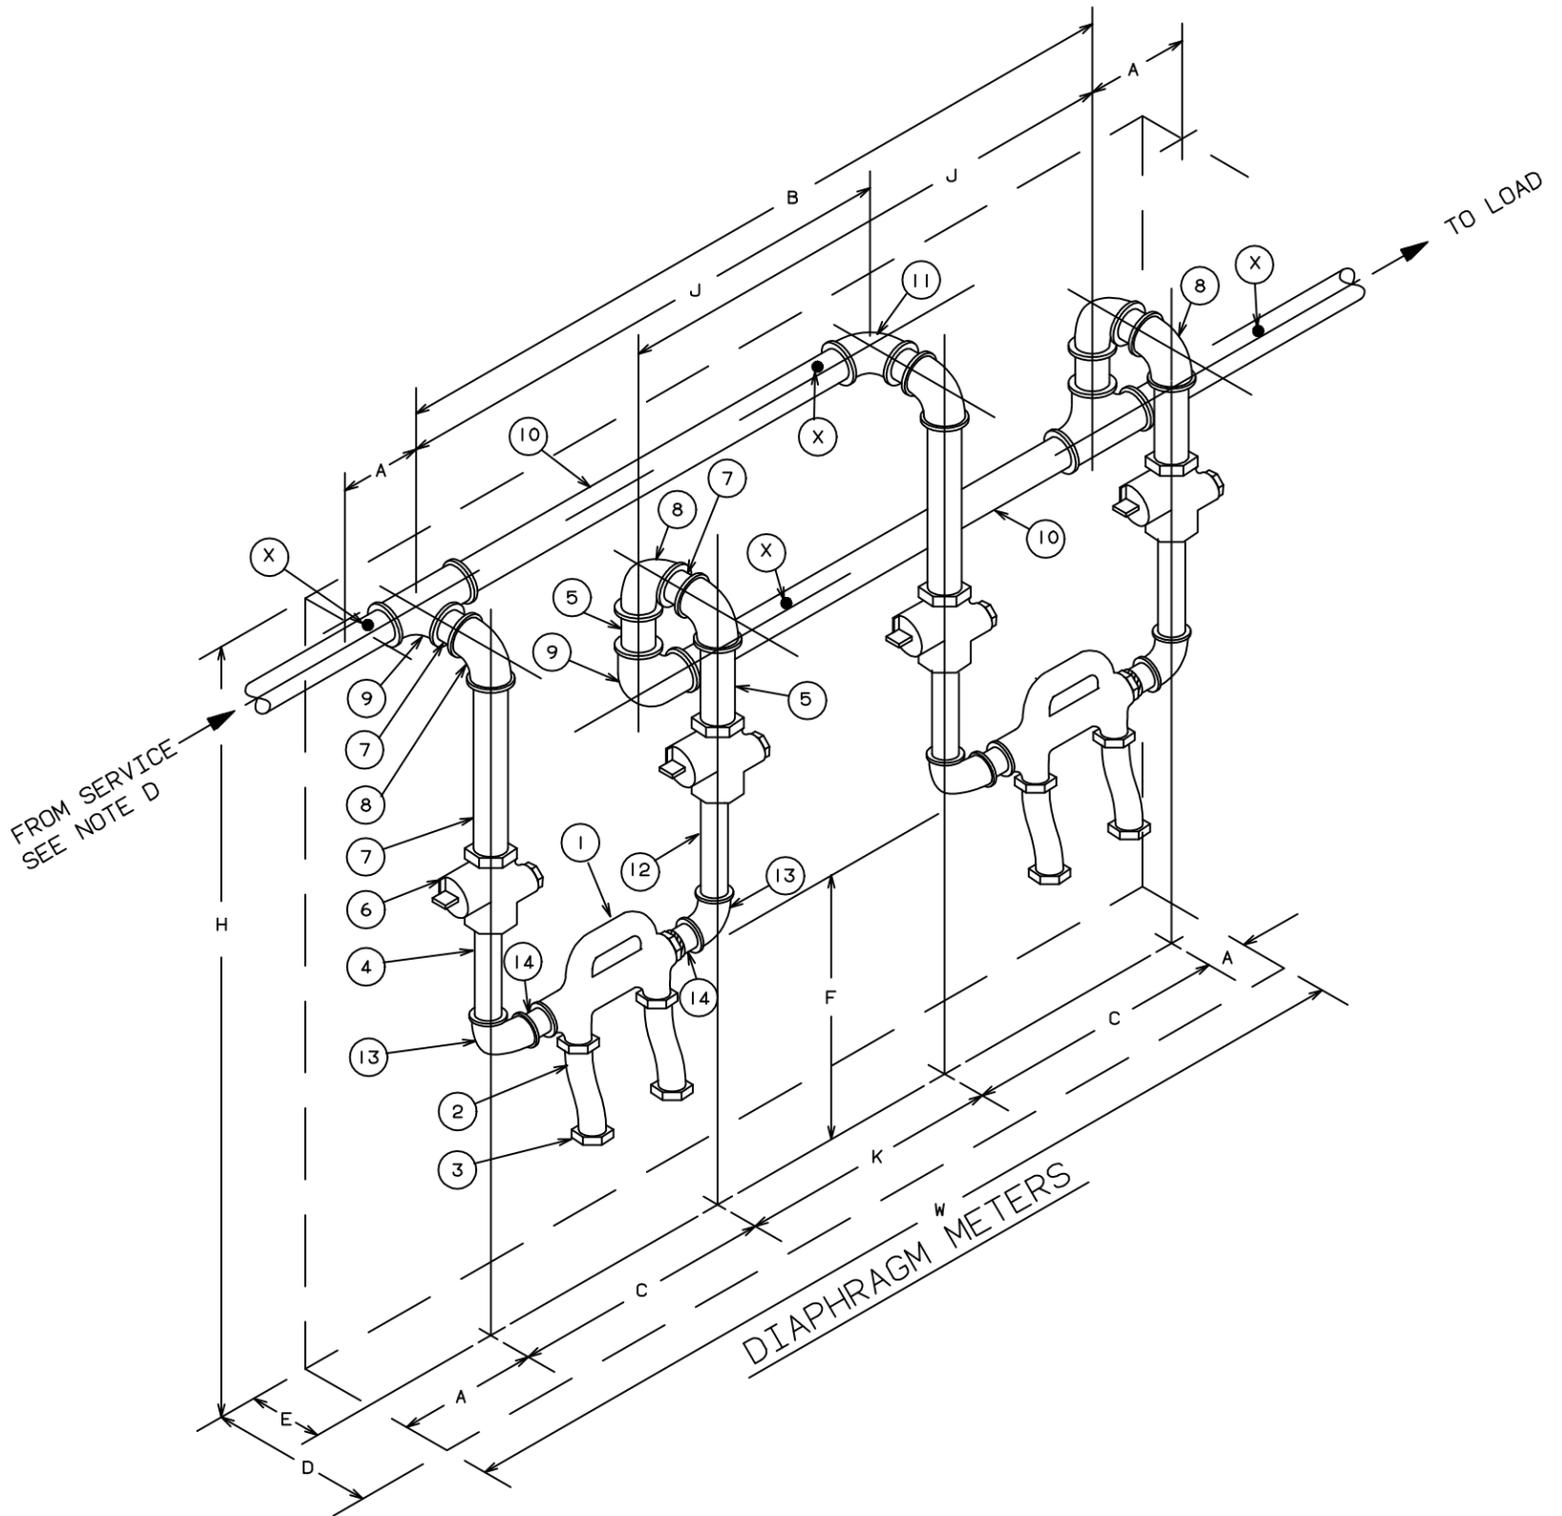

H	HEIGHT (MIN.)	66"
W	CLEARANCE LEFT TO RIGHT	67"
D	CLEARANCE FROM WALL	48"
MINIMUM SPACE REQUIRED		
K	¢ TO ¢ OF PIPES	12"
J	¢ TO ¢ OF PIPES ON HEADER	27 1/2"
F	BOTTOM OF METER BAR TO FLOOR(MIN.)	50"
	BOTTOM OF METER BAR TO FLOOR(MAX.)	82"
E	¢ OF METER BAR TO REAR WALL	9"
C	¢ TO ¢ IN/OUTLET PIPING	16 1/2"
B	¢ TO ¢ OF PIPES	43"
A	CLEARANCE FROM ¢ OF PIPE	12"

DIMENSIONS		
16	ELBOW	1"
15	NIPPLE	1" x 2"
14	NIPPLE	1" x 2"
13	ELBOW	1"
12	NIPPLE	1" x 5"
11	ELBOW, REDUCING FROM HEADER SIZE TO:	1"
10	HEADER (MIN.)	1 1/2"
9	ELBOW, REDUCING FROM HEADER SIZE TO:	1"
8	ELBOW	1" x 1"
7	NIPPLE	1"
6	METER VALVE *	1"
5	NIPPLE	1" x 2"
4	NIPPLE	1" x 5"
3	SWIVEL CAP	20 LT.

2	SWIVEL	PART OF A.Y McDONALD BYPASS METER BAR ASSEMBLY
1	BYPASS METER BARS *	A.Y McDONALD 6410 FFE-W 1X1X1 BYPASS MTR BAR
ITEM NO.	METER CLASS-PROC. G-48	250 TC
	DESCRIPTION	

METER SPECIFICATIONS AND PROCEDURES VOLUME NO. 3 AND YELLOW BOOK

BILL OF MATERIAL

NOTES:

- (A) ALL MATERIAL SHALL BE FURNISHED AND INSTALLED BY CUSTOMER.
- (B) ALL PIPING SHALL BE INSTALLED PLUMB AND LEVEL.
- (C) ALL PIPE TO BE STANDARD WALL STEEL, ALL FITTINGS TO BE 150 LB STANDARD WALL MALLEABLE IRON.
- (D) WHERE SERVICE PIPE IS BURIED STEEL, INSTALL INSULATED COUPLING BETWEEN SERVICE HEAD VALVE AND METER.
- (E) PIPING MUST BE LEFT CAPPED BY CONTRACTOR PRIOR TO METER INSTALLATION.
- (F) FOR CLASS 250 TC GAS METERS, METER BAR SHALL BE A.Y. McDONALD 6410 FFE-W 1X1X1
- (G) ALL PIPE AND FITTINGS SHALL BE SCHEDULE 40.

* SEE "A CUSTOMER GUIDE TO NATURAL GAS SERVICE INSTALLATION" (YELLOW BOOK)

(X) SUPPORT PIPING FROM WALL OR CEILING AT POINTS INDICATED.

SPEC. NO. G-317

**INSTALLATION OF TWIN
CLASS 250 TC
DIAPHRAGM
GAS METERS-INDOORS**

CONSOLIDATED EDISON COMPANY OF N. Y. INC.
GAS OPERATIONS DEPT.

DATE 5/12/49 DWG. NO. **EO-7421-B** REV. **20**
LAST REV. 6/1/16