
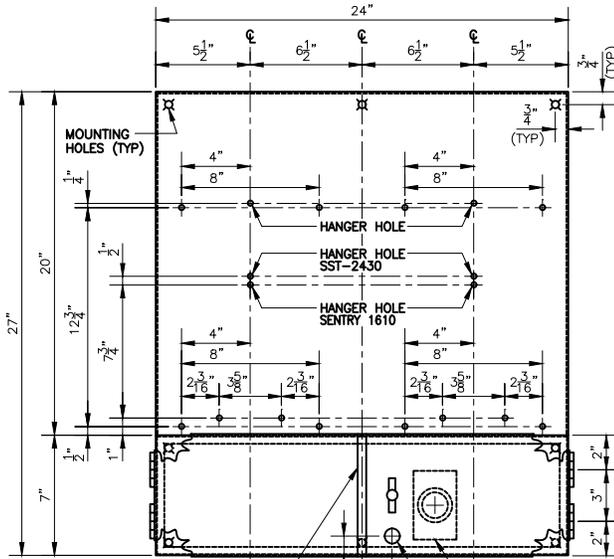


8-15934-E0

REVISIONS

V. FERGIJSON 10/16/01	3
REDRAWN TO AUTOCAD. ELIMINATED MOUNTING HOLES NOT NEEDED AND ADDED HOLES FOR NEW DEVICES. CHANGED NOTES 3 & 6. REMOVED DETAILS A & B. G.D. 10/16/01	
C. MAGOULAS 4/15/2011	4
CHANGED DEPARTMENT TO ELECTRIC METER SHOP.	
A.V. 4/12/11	
A. Miller 4/15/2016	5
CHANGED REV. DATE.	
L.L. 4/15/16	
A. MILLER 12/22/22	6
CONTENT REVIEWED AND UPDATED. DRAWING CONVERTED TO DWG FILE FROM PAPER. 12/22/22	


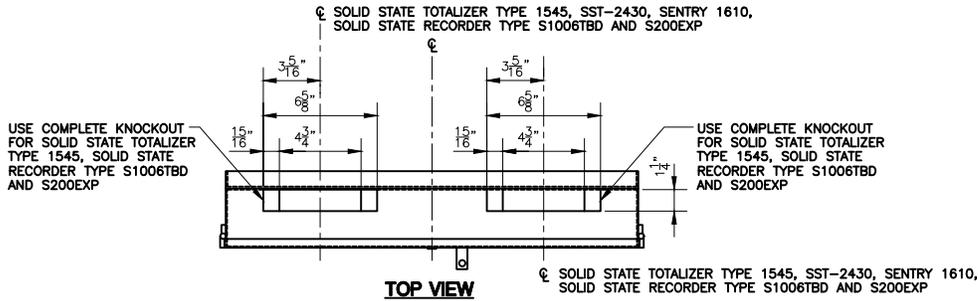


PROVIDE DOORS WITH 1/2" OVERLAP ON FRONT ONLY

7/8" DIA. KNOCKOUT FOR BARREL LOCK ADAPTING BUSHING WITH SEALING PROVISION (BROOKS NO. 865-05 OR EQUAL) AND FLANGE TYPE RECEIVING BRACKET (E.J. BROOKS NO.869 OR EQUAL). LOCATE 1 1/8" FROM INSIDE BOTTOM OF BOX.

15 AMP. PLUG FUSE RECEPTACLE

NOTE:
DIMENSIONS TAKEN OFF CABINET, NOT DOOR

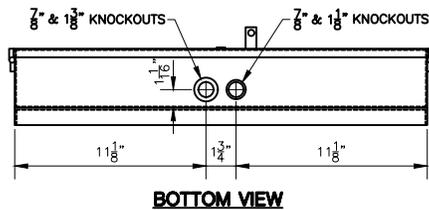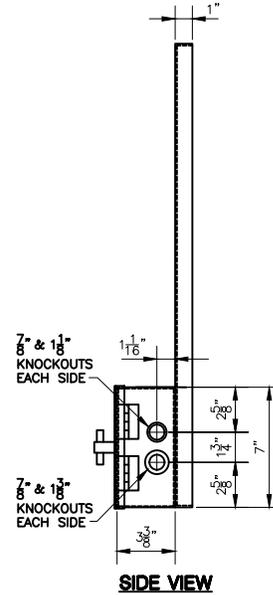

HOLES SHOWN \otimes ARE 7/16" DIA.
HOLES SHOWN \circ ARE 1/4"-20 TAP

NOTES:

1. THE CABINET SHALL BE OF NO.14 U.S.S. GAUGE, AND THE BACK PLATE OF NO.12 U.S.S. GAUGE SHEET STEEL.
2. UNLESS OTHERWISE SPECIFIED TOLERANCE ON HORIZONTAL TAPPED HOLES TO BE $\pm .010"$, AND TAPPED HOLES SHALL HAVE AT LEAST THREE COMPLETE THREADS.
3. ALL STEEL SURFACES SHALL HAVE A PROTECTIVE COATING OF GRAY AIR DRY ENAMEL. (ASA 61 COLOR) WATER BASE.
4. CABINET DOORS SHALL BE PROVIDED WITH CATCHES AND FACILITIES TO ACCOMMODATE STANDARD SEALS AND PADLOCK WITH 5/16" DIA. HASP.
5. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS, AND THE DEPARTMENT OF BUILDINGS OF THE CITY OF NEW YORK.
6. SAMPLES OF THE EQUIPMENT SHALL BE SUBMITTED TO ELECTRIC METER SHOP FOR APPROVED LISTING.

**MOUNTING EQUIPMENT 24" X 27"
FOR DEMAND METERING DEVICES
REVENUE METERING
MES 104-A**

CONSOLIDATED EDISON COMPANY OF N.Y., INC.
ELECTRIC METER SHOP

DATE 12/22/22 DWG. NO. **EO-15934-B** REV. 6
LAST REV. 12/22/22

FIELD MANUAL NO. 4 SECTION 6 METER INSTALLATION
FIELD MANUAL NO. 16 SECTION 3 ELECTRIC METERING

COMPUTER GENERATED DRAWING NOT TO BE HAND REVISED

DESIGN BY V.F.	CHECKED BY V.F.	DATE 10/16/01	SCALE 1/4"=1"
APPROVED BY	DATE	DATE	DATE