


E-015403-B

REVISIONS

|           |      |                                   |
|-----------|------|-----------------------------------|
| DATE      | BY   | DESCRIPTION                       |
| 3/19/75   | MS   | ADDED NOTES AND UPDATED DWG.      |
| 2-26-85   | MS   | C.N. 2-26-85                      |
| 9/10/86   | MS   | CHGD. NOTES & TITLE               |
| 8-9-11-86 | MS   | C.N. 8-9-11-86                    |
| 10-13/88  | MS   | CHGD. NOTE 6                      |
| 10-7-88   | J.L. | REMOVED 11/32" DIA. HOLE IN COVER |
| 3-6-93    | MS   | CHGD. NOTE 4                      |
| 3-4-93    | GR   | REMOVED 11/32" DIA. HOLE IN COVER |

ENG. A MILLER  
 REVIEWED DRAWING  
 NO CHANGES MADE  
 ISSUE FOR RECORD  
 DES. N. POLYDOROU  
 5/20/16

5

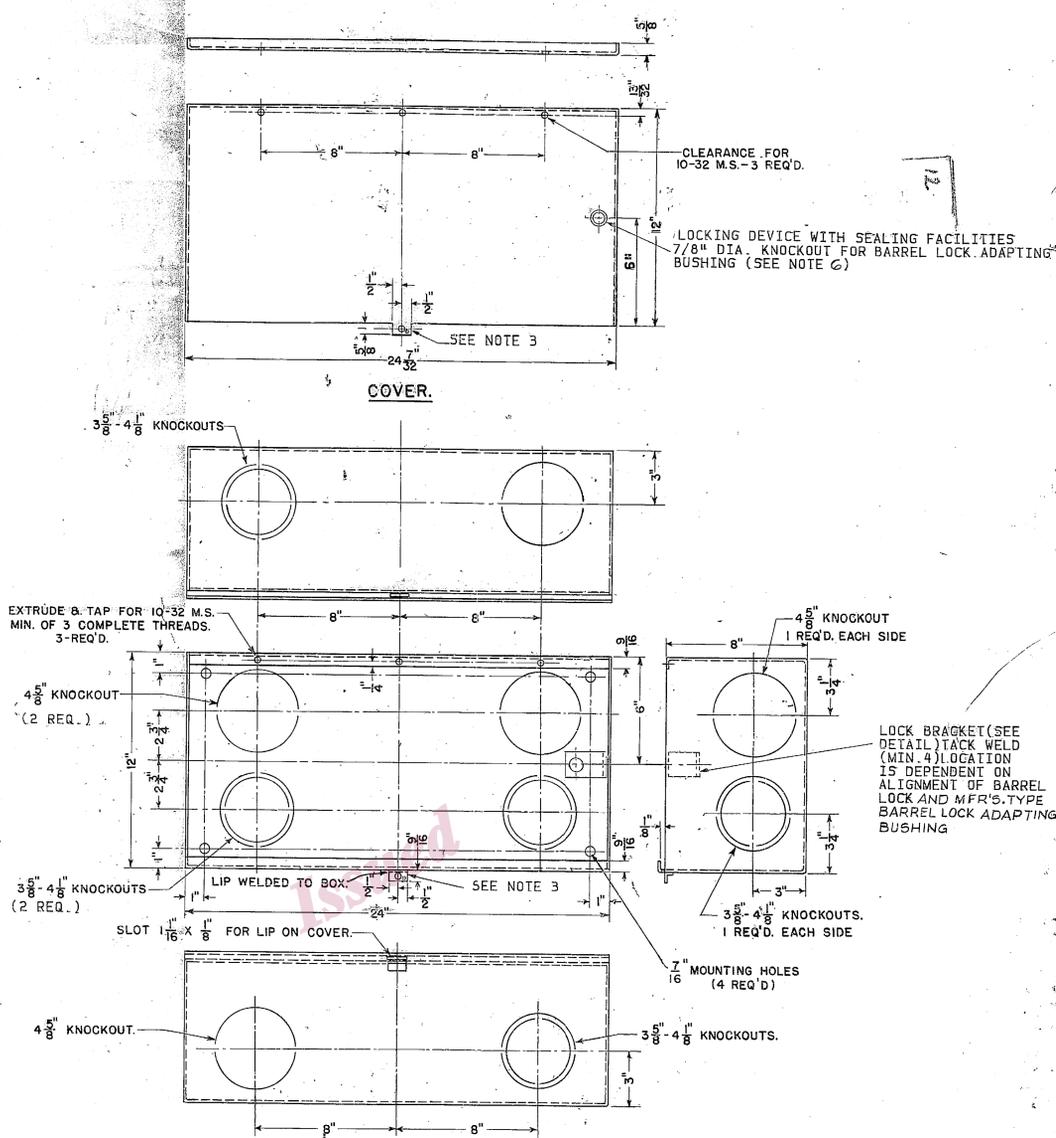

NOTES:

1. THE SERVICE END BOX COVER SHALL BE NO 14 U.S. STANDARD GAUGE GALVANIZED SHEET STEEL AND HAVE A FINISH OF BAKED GRAY ENAMEL.
2. KNOCKOUT DIMENSIONS INDICATE ACTUAL DIAMETER OF KNOCKOUT AND NOT SIZE OF CONDUIT.
3. SEALING FACILITIES SHALL ACCOMMODATE STANDARD SEALS AND PADLOCK WITH 5/16" DIAMETER HASP.
4. FOR OUTDOOR TYPE A SERVICE END BOX AND COVER SHALL BE CONSTRUCTED AND DESIGNATED "RAINTIGHT".
5. A NAMEPLATE SHALL BE PLACED ON THE OUTSIDE OF THE COVER AND CONTAIN THE MANUFACTURER'S NAME AND CATALOG NUMBER.
6. FOR INDOOR ENCLOSURES, USE HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE, CATALOG NO. 93389000, HIGHFIELD MFG. CO., BRIDGEPORT, CONN. OR BROOKS LOCK GUARD, CATALOG NO. 86505, E. J. BROOKS, NEWARK, NEW JERSEY, OR INNER-TITE LOCK HEAD PROTECTOR WITH SEALING FERRULE, CATALOG NO. 2-0090A, INNER-TITE CORP., SPRINGFIELD, NEW JERSEY, FOR OUTDOOR "RAINTIGHT" ENCLOSURES, USE HIGHFIELD LOCK RECEPTACLE WITH SEAL FERRULE AND GASKETS, CATALOG NO. 93388337, OR BROOKS LOCK GUARD CATALOG NO. 865150.
7. THE EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS, THE DEPT. OF BUILDINGS OF THE CITY OF NEW YORK AND UNDERWRITERS LABORATORIES, INC. PUB. NO. 50.
8. SAMPLES OF THE EQUIPMENT SHALL BE SUBMITTED TO THE DISTRIBUTION INSTRUMENTATION ENGINEER FOR APPROVAL.

THIS DWG. SUPERSEDES DWG. U-19929

SERVICE END BOX  
 FOR INDOOR OR OUTDOOR LOCATIONS  
 24" X 12" X 8"

CONSOLIDATED EDISON COMPANY OF N. Y., INC.  
 ELECTRICAL ENGINEERING DEPT.

DATE 1-24-74 SPEC. NO. MES 215 REV. 5  
 LAST REV. 5-20-16

FIELD MANUAL NO. 4  
 SECTION 6  
 FIELD MANUAL NO. 16  
 SECTION 3

TRIM LINE

| NO. | DATE | REVISIONS | APPROVED |
|-----|------|-----------|----------|
|     |      |           |          |
|     |      |           |          |

| FOR APPROVAL | DIV. | SIGNATURE | DATE | DRAWN BY | DATE    | CHECKED BY | DATE |
|--------------|------|-----------|------|----------|---------|------------|------|
|              |      |           |      | DIRICO   | 1-24-74 |            |      |
|              |      |           |      |          |         |            |      |

E-015403-B